

ORIGINAL
(Red)

SPCC Inspection REPORT

CASE # : MD-84-097

DATE OF TARGET:

FACILITY NAME: CATO INC. (TEXACO TERMINAL)
ADDRESS: P.O. BOX 1036 MARINE Rd.
SALISBURY MD 21801

COUNTY: WICOMICO

TARGET BY:

PHONE: (301)546-1215

FAC. REP.: GEORGE EVANS
TITLE: MANAGER

DATE INSPECTED: 07/31/84

INSPECTORS: C. LEE

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:
ADDRESS:

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: 1957

DATE PLAN REQ'D: 1974

OIL STORAGE CAPACITY ABOVEGROUND: 3,792,000 GALLONS
UNDERGROUND: GALLONS

SPCC PLAN PREPARED: Y AVAILABLE FOR REVIEW: Y

DATE CERTIFIED: 07/19/74 SEAL AFFIXED: Y

ENGINEER: ANTHONY L. ANDUJAR

LICENSE #:711-E STATE: PA

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS: Y

DATES OF REVIEW: 5/6/77;4/22/80;5/14/83

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N

TWO SPILLS IN PAST 12 MONTHS: N

ENFORCEMENT ACTIVITIES

NON DATE: NOV CASE #:

REFERRED TO ORC: ASSIGNED TO:

PROPOSED PENALTY: 0 NOV SENT:

ORC PENALTY: 0 HEARING DATE:

AMOUNT SETTLED: 0 DATE SETTLED:

AMOUNT COLLECTED: 0 DATE COLLECTED:

CASE CLOSED:

COMMENTS:

ORIGINAL
(Red)

SPCC INSPECTION DATABASE

CASE # : MD-84-097 DATE OF TARGET: _____
FACILITY NAME: CATO INC. (TEXACO TERMINAL)
ADDRESS: P.O. Box 1036 MARINE Rd.
SALISBURY, MD. 21801
COUNTY: Wicomico TARGET BY: _____
PHONE: 301-546-1215 FAC. REP. GEORGE EVANS MGR.
DATE INSPECTED: 7-31-84 INSPECTORS: CESAR LEE

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME: _____
ADDRESS: _____
PHONE: _____ FAC. REP. _____

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: 1957 DATE PLAN REQ'D: 1974
OIL STORAGE CAPACITY ABOVEGROUND: 3,792,000 GALLONS
UNDERGROUND: _____ GALLONS
SPCC PLAN PREPARED: Y (Y/N) AVAILABLE FOR REVIEW: Y (Y/N)
DATE CERTIFIED: 7-19-74 SEAL AFFIXED: Y (Y/N)
ENGINEER: ANTHONY L. ANDUSTAR LICENSE #: 711-E STATE: PA
FAC. RECORD OF REVIEW OF PLAN EVERY THREE YEARS: 3 (Y/N)
DATES OF REVIEW: 5-14-83-4-22-80-5-6-77
SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N (Y/N)
TWO SPILLS IN PAST 12 MONTHS: N (Y/N)

ENFORCEMENT SCREEN

NON DATE: _____
NOV CASE #: _____ REFERRED TO ORC: _____
ASSIGNED TO: _____
PROPOSED PENALTY: _____ NOV SENT: _____
ORC PENALTY: _____ HEARING DATE: _____
AMOUNT SETTLED: _____ DATE SETTLED: _____
AMOUNT COLLECTED: _____ DATE COLLECTED: _____
CASE CLOSED DATE: _____

SPCCDAT2

POSE 1783
TDD# 8407-10

SPCC PLAN INSPECTION

A. Facility Name CATO INC. (TEXACO TERMINAL)
Address PO Box 1036 Marine Rd
Salisbury, MD 21801 (ZIP)

County Wicomico

Phone No. 301-546-1215

Contact: GEORGE EVANS Title: OPS MANAGER

B. Has an SPCC Plan been prepared? Yes No

Has an SPCC Plan been implemented? Yes No

Has it been certified by a Registered Professional Engineer? Yes No

Name ANTHONY L. ANDUJAR No. 711-E State PA

C. Facility start-up date 1957

D. Date SPCC plan was certified 7/19/74

E. Date(s) Plan Revised N/A

F. Date(s) Plan Reviewed 5/14/83; 4/22/80; 5/6/77

G. Has the name of the facility changed within the last year? Yes No

H. Has the location of the facility changed within the last year? Yes No

I. Closest water body Wicomico River Distance 2000ft

J. Above Ground Storage Product Below Ground Storage Product

see plan/nop

SPCC PLAN INSPECTION

IDDP 8407-20

Page 2

K. Comments:

- a. Diking Type gravel on top of sand Appears Adequate
- b. Manual valve on dike drain
- c. Sorbents or booms stored on site
- d. Curbing at load or unload area
- e. Drainage at load or unload areas to oil/water separator
- f. Underground tanks checked N/A Time span _____
- g. High level alarms on tanks
- h. Security Type Fenced & Barbed
- i. Personnel training continuous
- j. Spill history none

s. Monthly water samples for analysis done
 a see attached plan drawing

L. Estimated number of man hours involved in inspection 100 (whole hours)


"I certify the above to be accurate to the best of my knowledge."

Inspected by C. S. [Signature]

Company Official [Signature]

Date 7/31/84

BY CL DATE 7/31/88 DIV _____ SHEET 3 OF 7
 CHKD BY _____ DATE _____ DEPT T&E III W.O. NO. _____
 PROJECT SPCC / Wicomico, MD
 SUBJECT CAT, Inc ; Salisbury, MD

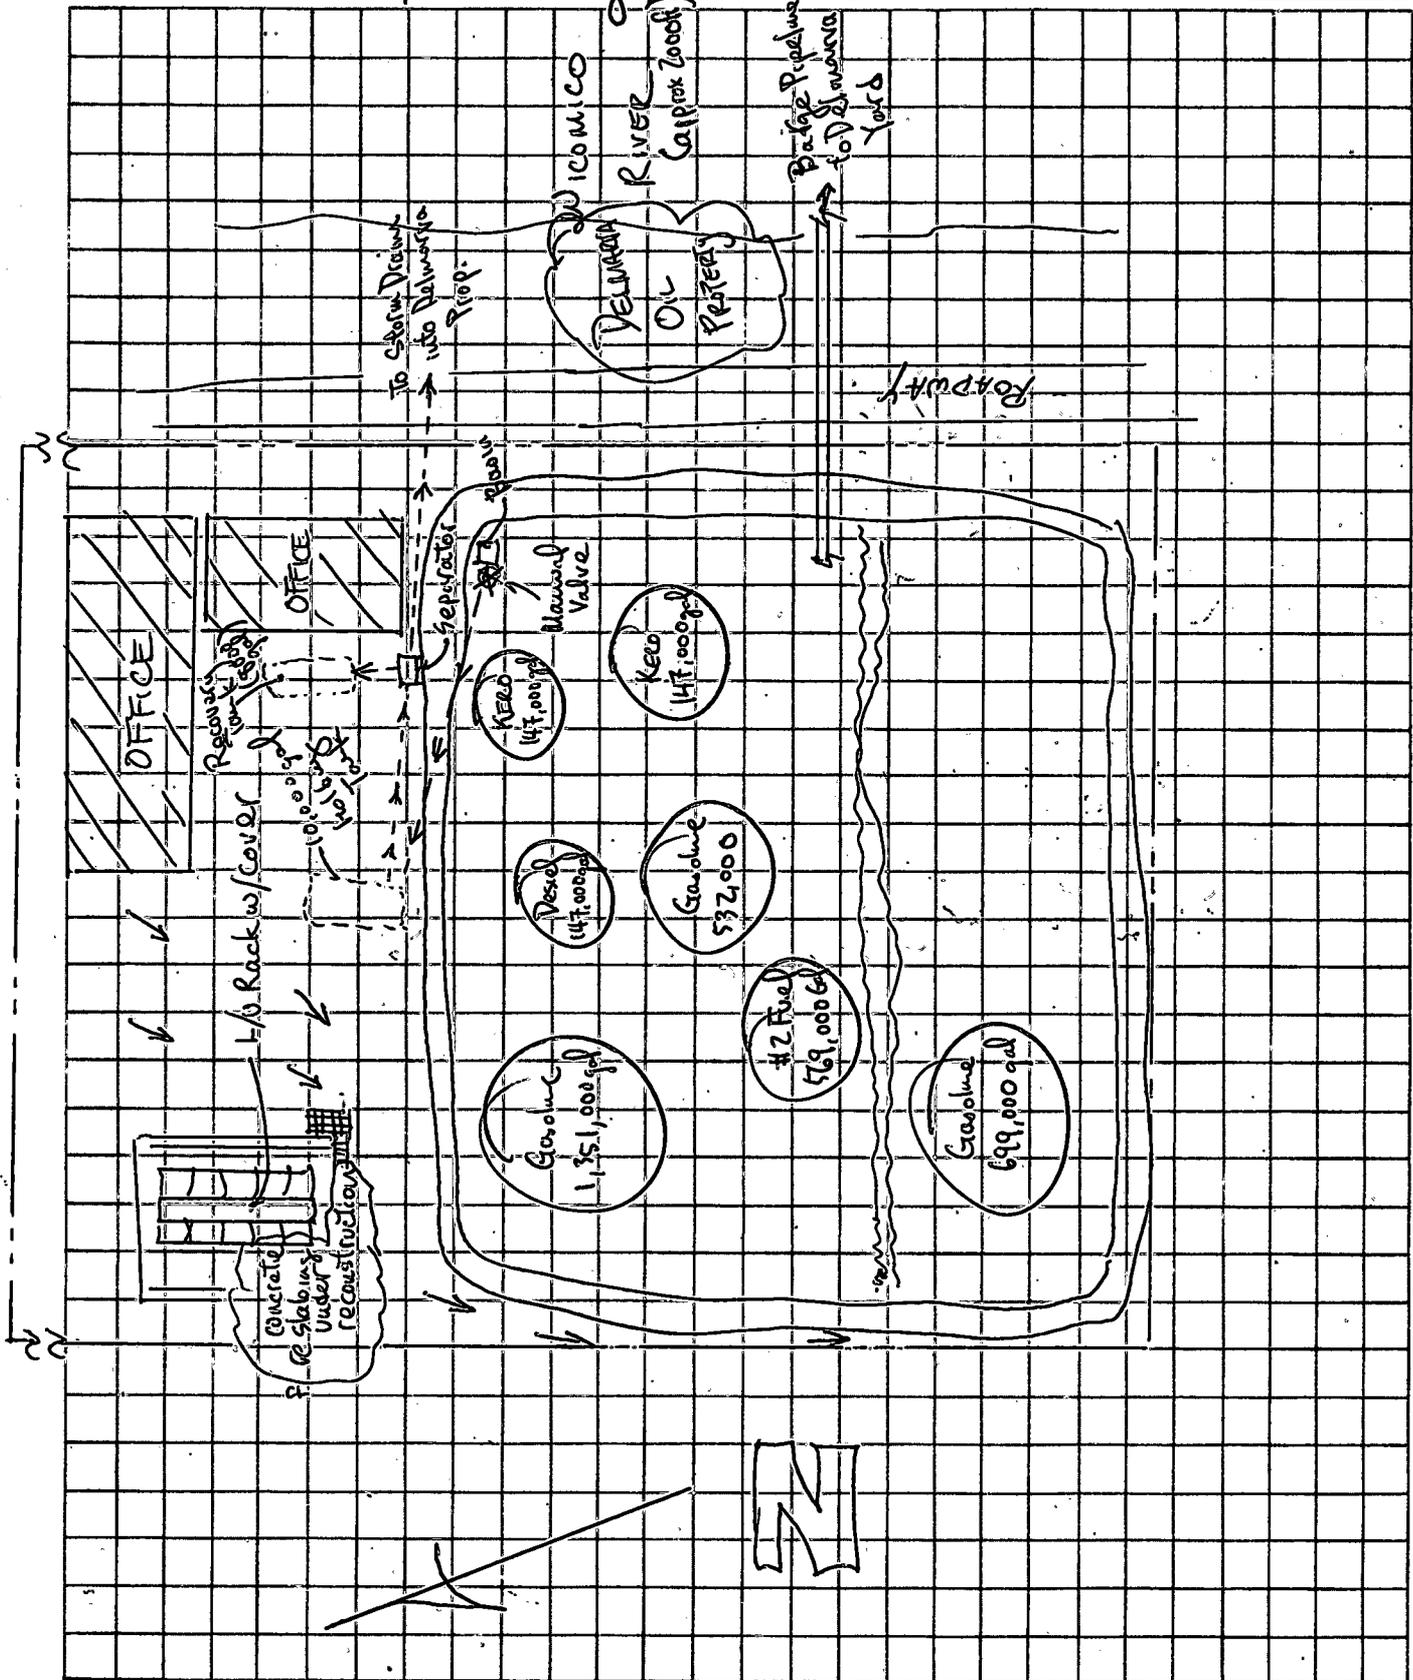

SPCC INSPECTION DATABASE

CASE # : MD-84-099 DATE OF TARGET: _____
FACILITY NAME: GULF OIL PRODUCTS CO.
ADDRESS: P.O. BOX 830, MARINE RD.
SALISBURY, MD. 21801
COUNTY: WICOMICO TARGET BY: _____
PHONE: 301-712-1555 FAC. REP. JUDY TAYLOR, SUPER.
DATE INSPECTED: 7-31-84 INSPECTORS: C. LEE.

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME: _____
ADDRESS: _____
PHONE: _____ FAC. REP. _____

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: 1957 DATE PLAN REQ'D: 1974
OIL STORAGE CAPACITY ABOVEGROUND: 4,877,904 GALLONS
UNDERGROUND: _____ GALLONS
SPCC PLAN PREPARED: Y (Y/N) AVAILABLE FOR REVIEW: Y (Y/N)
DATE CERTIFIED: 6-11-74 SEAL AFFIXED: Y (Y/N)
4-27-82
ENGINEER: VICTOR F. METERS JR. LICENSE #: 4499 STATE: MD.
FAC. RECORD OF REVIEW OF PLAN EVERY THREE YEARS: _____ (Y/N)
DATES OF REVIEW: 7-31-84
SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N (Y/N)
TWO SPILLS IN PAST 12 MONTHS: N (Y/N)

SPCC PLAN INSPECTION

TDD# 8407-20

Page 2

K. Comments:

- a. Diking Type Earth Appears Adequate
- b. Manual valve on dike drain (normally capped & locked)
- c. Sorbents or booms stored on site
- d. Curbing at load or unload area
- e. Drainage at load or unload areas to oil water separator
- f. Underground tanks checked N/A Time open _____
- g. High level alarms on tanks NA
- h. Security Type Fenced & Barb except @ River
- i. Personnel training (use out-of-plant drivers)
- j. Spill history None

* Gulf will be changed to "Standard of Southern Cal.f." as of 8/3/84

L. Estimated number of man hours involved in inspection 2.0 (whole hours)

"I certify the above to be accurate to the best of my knowledge."

Inspected by *C. S. ...*

Company Official *Judy M. Taylor*

Date 7/31/84

WICOMICO RIVER

EXXO
~~EXXON~~ TERMINAL - Property Line

NEW LINE OPENED
by state Hwy.

To River
(approx 1/8 mi)

OUTFALL

Filter Box

YARD DRAIN
VALVE (LOCKED)

LEADED
GASOLINE
105

#2 FUEL
oil
104

Gulf

KERO
103

UNLEADED
GASOLINE
102

UNLEADED
GASOLINE
106

UNLEADED
GASOLINE
101

OFFICE
BLDG.

Separate

8000 Gal
U.G. TANK

Storm
Drain

TRENCH
Drain

Rack

TRENCH
Drain

Storm
Drain

Wooded
Area

FIRE Pump House

DOCK AREA ROAD

Property 1500' Long (Approx 1000' shown)

Stewart
~~Stewart~~ Petroleum - Property Line

MAINE ROAD

FARM FIELD

ORIGINAL
Red

3/19/82
RTR

ORIGINAL
(Red)

SPCC Inspection REPORT

CASE # : PA-75-033

DATE OF TARGET:

FACILITY NAME: TEXACO, INC.

ADDRESS: 9 THORN STREET
CORAOPOLIS,

PA

COUNTY: ALLEGHENY

TARGET BY:

PHONE: (412)331-3400

FAC. REP.: E. J. OWENS

TITLE: TERMINAL SUPER.

DATE INSPECTED: 04/07/75

INSPECTORS: RICHARD W. FULLNER

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:

ADDRESS:

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE:

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND: 39,480,000GALLONS

UNDERGROUND: 15,000GALLONS

SPCC PLAN PREPARED: Y

AVAILABLE FOR REVIEW: Y

DATE CERTIFIED:

SEAL AFFIXED: Y

ENGINEER:

LICENSE #:

STATE:

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS:

DATES OF REVIEW:

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N

TWO SPILLS IN PAST 12 MONTHS: N

COMMENTS:

PA-75-033

SPCC PLAN INSPECTION

ORIGINAL
(Red)

Facility name Texaco, Inc.

Address 9 Thorn St.

Coraopolis, Pa. 15108 ALLEGHENY COUNTY

Telephone No. 412-331-3400

Has an SPCC Plan been prepared? Yes No

Has it been certified by a Registered Professional Engineer? Yes No

Name of person contacted: E. J. Owens
Terminal Superintendent

Means of contact: At facility Nearest Office

Telephone Other

Comments:

Storage: 39,480,000 above ground
15,000 under ground

Plan is very complete.

Inspected by Richard W. Fullner

Wheeling Field Office

Date: 4-7-75

Time: 1115

ORIGINAL
(Red)

SPCC Inspection REPORT

CASE # : PA-75-035

DATE OF TARGET:

FACILITY NAME: ARCO POLYMERS, INC.

ADDRESS: BEAVER VAL. PLNT-FRANKFORT RD.
MONACA, PA

COUNTY: BEAVER

TARGET BY:

PHONE: (412)774-1000

FAC. REP.: R.B. COUGHANOUR
TITLE: PH ENGINEER

DATE INSPECTED: 04/15/75

INSPECTORS: RICHARD W. FULLNER

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:
ADDRESS:

PHONE:

FAC. REP: J. E. GRANDE

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE:

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND: 1,000,000 GALLONS
UNDERGROUND: GALLONS

SPCC PLAN PREPARED: Y

AVAILABLE FOR REVIEW: Y

DATE CERTIFIED:

SEAL AFFIXED: Y

ENGINEER:

LICENSE #:

STATE:

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS:
DATES OF REVIEW:

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N
TWO SPILLS IN PAST 12 MONTHS: N

COMMENTS:

PA-75-035

SPCC PLAN INSPECTION

ORIGINAL
(Red)

Facility name ARCO Polymers Inc., Beaver Valley Plant

Address Frankfort Road

Monaca, PA 15061 BEAVER COUNTY

Telephone No. 412-774-1000

Has an SPCC Plan been prepared? Yes No

Has it been certified by a Registered Professional Engineer? Yes No

Name of person contacted: R.E. Coughanour, PH Manager * (1980 Mr. McC2/b)
J.E. Grande, Chief Process Engineer

Means of contact: At facility Nearest Office

Telephone Other

Comments:

This facility has fuel oil storage of about 1,000,000 gallons.

The Plan appears to be very complete.

* Scott McPhillamy checked again on 7/2/76

Inspected by Richard W. Fullner
Wheeling Field Office

Date: 4-15-75

Time: 1045

Mr.

ORIGINAL
(Red)

SPCC INSPECTION DATABASE

CASE # : PA-82-030 DATE OF TARGET: _____

FACILITY NAME: ADD CHEMICAL, INC.

ADDRESS: FRANKFORT ROAD
MONACA, PA. 15061

COUNTY: BEAVER TARGET BY: _____

PHONE: 412-774-1000 FAC. REP. MIKE REINER, ENGR. ENGR.

DATE INSPECTED: NOV 19, 1982 INSPECTORS: JERRY SASEEN

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME: _____

ADDRESS: _____

PHONE: _____ FAC. REP. _____

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: _____ DATE PLAN REQ'D: _____

OIL STORAGE CAPACITY ABOVEGROUND: 285,000 GALLONS
UNDERGROUND: 15,000 GALLONS

SPCC PLAN PREPARED: Y (Y/N) AVAILABLE FOR REVIEW: Y (Y/N)

DATE CERTIFIED: _____ SEAL AFFIXED: Y (Y/N)

ENGINEER: LA-VETTER LICENSE #: PE-002844-ESTATE: PA.

FAC. RECORD OF REVIEW OF PLAN EVERY THREE YEARS: _____ (Y/N)

DATES OF REVIEW: _____

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N (Y/N)

TWO SPILLS IN PAST 12 MONTHS: N (Y/N)

SPCCDATA.

SPCC PLAN INSPECTION

ORIGINAL
(Red)

A. Facility Name ARCO CHEMICAL, INC.

Address FRANKFORT ROAD

MONACA, PA. 15061

(Zip)

Telephone No. 412-774-1000

Contact: Mike Reiner Title: Environmental Eng.

B. Has an SPCC Plan been prepared? Yes No

Has an SPCC Plan been implemented? Yes No

Has it been certified by a Registered Professional Engineer? Yes No

Name J.A. Vetter No. PE-002844-E State PA

C. Closest water body Ohio (MP 30.0) Distance On River

D. Facility start-up date _____

E. Storage:	Underground (X)	Above Ground (X)	Product
1		225,000 gallons	Fuel Oil
3		20,000 "	Fuel Oil
1	10,000 Gallons		Fuel Oil
1	5,000 Gallons		Gasoline

F. Comments: (Home Office, recent spills, etc.)
Company plan was reviewed and found to be in compliance with the SPCC regulations.

Inspected by Jerry Saseen

Date 11/19/82

SPCC INSPECTION DATABASE

CASE # : PA-82-028 DATE OF TARGET: _____

FACILITY NAME: SHELL CHEMICAL COMPANY

ADDRESS: 96 GREAT LAKES TERMINAL & TRANSPORT CORP.
INDUSTRY, PA. 15052

COUNTY: BEAVER TARGET BY: _____

PHONE: 412-643-9451 FAC. REP. TOM GIMBERS, TERMINAL MGR.

DATE INSPECTED: DEC. 16, 1981 INSPECTORS: JERRY SASEEN

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME: _____

ADDRESS: _____

PHONE: _____ FAC. REP. _____

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: _____ DATE PLAN REQ'D: _____

OIL STORAGE CAPACITY ABOVEGROUND: 278,000 GALLONS
UNDERGROUND: _____ GALLONS

SPCC PLAN PREPARED: Y (Y/N) AVAILABLE FOR REVIEW: Y (Y/N)

DATE CERTIFIED: _____ SEAL AFFIXED: Y (Y/N)

ENGINEER: DANIEL BAKER LICENSE #: 5587-E STATE: PA

FAC. RECORD OF REVIEW OF PLAN EVERY THREE YEARS: _____ (Y/N)

DATES OF REVIEW: _____

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N (Y/N)

TWO SPILLS IN PAST 12 MONTHS: N (Y/N)

SPCCDATA.

SPCC PLAN INSPECTION

ORIGINAL
(Red)

A. Facility Name Shell Chemical Company
 Address c/o Great Lakes Terminal & Transport Corp.
Industry, PA. 15052
 (Zip)

Telephone No. 412-643-9451

Contact Tom Gimbers Title: Terminal Manager

B. Has an SPCC Plan been prepared? Yes X No _____
 Has an SPCC Plan been implemented? Yes X No _____
 Has it been certified by a Registered Yes X No _____
 Name Daniel Baker No. 5587-E State PA

C. Closest Water Body Ohio River Distance 200 ft.

D. Facility start-up date _____

E. Storage:	Underground ()	Above Ground (x)	Product
7		10,000 gal.	Industrial
8		10,000 "	Chemical
5		5,000 "	"
3		1,000 "	"
4		15,000 "	"
2		20,000 "	"

F. Comments: (Home Office, recent spills, etc.)
 Company was found to be in compliance with the Federal Regulations.
 Company is presently installing underground tanks for additional storage.

Inspected by J. Saseen

Date 12/16/81

ORIGINAL
(Red)

SPCC Inspection REPORT

CASE # : PA-81-044

DATE OF TARGET:

FACILITY NAME: UNITED REFINING CO. - KEYSTONE

ADDRESS: McNAUGHTON OIL CO-P.O. BOX 615
INDIANA, PA

COUNTY: INDIANA

TARGET BY:

PHONE: (412)465-5615

FAC. REP.: DAVE McNAUGHTON
TITLE: MANAGER

DATE INSPECTED: 07/15/81

INSPECTORS: JERRY SASEEN

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:
ADDRESS:

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE:

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND:

GALLONS

UNDERGROUND:

992,000GALLONS

SPCC PLAN PREPARED: Y

AVAILABLE FOR REVIEW: Y

DATE CERTIFIED:

SEAL AFFIXED: Y

ENGINEER: WILLIAM L. WAGN LICENSE #:8911-2

STATE: PA

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS:

DATES OF REVIEW:

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: Y

TWO SPILLS IN PAST 12 MONTHS: Y

COMMENTS:

SPCC INSPECTION DATABASE

CASE # : PA-81-044
DATE OF TARGET: _____
FACILITY NAME: UNITED REFINING CO. - KEYSTONE McNAUGHTON OIL CO.
ADDRESS: P.O. BOX 615
INDIANA, PA 15701
COUNTY: INDIANA TARGET BY: _____
PHONE: 412-465-5615 FAC. REP. DAVE McNAUGHTON, MANAGER
DATE INSPECTED: JULY 15, 1981 INSPECTORS: JERRY SASEEN

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME: _____
ADDRESS: _____
PHONE: _____ FAC. REP. _____

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: _____ DATE PLAN REQ'D: _____
OIL STORAGE CAPACITY ABOVEGROUND: _____ GALLONS
UNDERGROUND: 97200 GALLONS
SPCC PLAN PREPARED: Y (Y/N) AVAILABLE FOR REVIEW: Y (Y/N)
DATE CERTIFIED: _____ SEAL AFFIXED: Y (Y/N)
ENGINEER: WILLIAM L. WAGNER LICENSE #: 8911-E STATE: PA
FAC. RECORD OF REVIEW OF PLAN EVERY THREE YEARS: _____ (Y/N)
DATES OF REVIEW: _____
SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: Y (Y/N)
TWO SPILLS IN PAST 12 MONTHS: Y (Y/N)

SPCCDATA.

SPCC PLAN INSPECTION

ORIGINAL
(Red)

A. Facility Name United Refining Company - Keystone McNaughton Oil Co.
 Address P. O. Box 615
Indiana, PA. 15701
 (Zip)

Telephone No. 412-465-5615

Contact Dave McNaughton Title: Mgr.

B. Has an SPCC Plan been prepared? Yes X No

Has an SPCC Plan been implemented? Yes X No

Has it been certified by a Registered Yes X No

Name William L. Wagner No. 8911-E State PA.

C. Closest Water Body Marsh Run Distance 200 ft.

D. Facility start-up date

E. Storage:	Underground (X)	Above Ground ()	Product
2	20,000		Fuel Oil
4	14,800		Kerosene
			Gasoline

F. Comments: (Home Office, recent spills, etc.)

Company's plan was reviewed and found to be in compliance with the SPCC regulations.

Inspected by Jerry Saseen

Date 7/15/81

SPCC Inspection REPORT

CASE # : PA-75-059

DATE OF TARGET:

FACILITY NAME: ARCO - PITTSBURGH TERMINAL

ADDRESS: 5733 BUTLER STREET
PITTSBURGH,

PA

COUNTY: ALLEGHENY

TARGET BY:

PHONE: (412)781-3410

FAC. REP.: R. E. SHAFFER
TITLE: TERMINAL SUPER.

DATE INSPECTED: 06/18/75

INSPECTORS: RICHARD W. FULLNER

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:
ADDRESS:

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE:

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND:

GALLONS

UNDERGROUND:

GALLONS

SPCC PLAN PREPARED: Y

AVAILABLE FOR REVIEW: Y

DATE CERTIFIED:

SEAL AFFIXED: Y

ENGINEER:

LICENSE #:

STATE:

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS:

DATES OF REVIEW:

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N

TWO SPILLS IN PAST 12 MONTHS: N

COMMENTS: TOTAL STORAGE AT THIS FACILITY IS 192,000 BARRELS IN 5
TANKS.

PA-75-059

SPCC PLAN INSPECTION

ORIGINAL
(Red)

Facility name ARCO - Pittsburgh Terminal

Address 5733 Butler Street

Pittsburgh, PA 15201 ALLEGHENY COUNTY

Telephone No. 412-781-3410

Has an SPCC Plan been prepared? Yes X No

Has it been certified by a Registered Professional Engineer? Yes X No

Name of person contacted: R. E. Shaffer
Terminal Superintendent

Means of contact: At facility X Nearest Office

Telephone Other

Comments:

Total storage at this facility is 192,000 barrels in 5 tanks.

This facility fronts on the Allegheny River at Mile 5.

The plan appears adequate.

Inspected by Richard W. Fullner

Wheeling Field Office

Date: 6-18-75

Time: 1030

ORIGINAL
(Red)

SPCC Inspection REPORT

CASE # : PA-81-007

DATE OF TARGET:

FACILITY NAME: UNITED REFINERY COMPANY

ADDRESS: 2318 WEST STATE STREET
NEW CASTLE, PA

COUNTY: LAWRENCE

TARGET BY:

PHONE: (412) 658-5557

FAC. REP.: ROBERT W. FENTZ, JR.
TITLE: OWNER DISTRIB.

DATE INSPECTED: 11/06/80

INSPECTORS: JERRY SASEEN

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:

ADDRESS:

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE:

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND:

45,000GALLONS

UNDERGROUND:

6,000GALLONS

SPCC PLAN PREPARED: Y

AVAILABLE FOR REVIEW: Y

DATE CERTIFIED:

SEAL AFFIXED: Y

ENGINEER: WILLIAM WAGNER

LICENSE #: 8911-F

STATE: PA

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS:

DATES OF REVIEW:

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N

TWO SPILLS IN PAST 12 MONTHS: N

COMMENTS:

ORIGINAL
(Red)
10/1/92

SPCC INSPECTION DATABASE

CASE # : PA-81-007 DATE OF TARGET: _____

FACILITY NAME: UNITED REFINERY COMPANY

ADDRESS: 2318 WEST STATE STREET
NEW CASTLE, PA 16101

COUNTY: LAURENCE TARGET BY: _____

PHONE: 412-558-5557 FAC. REP. ROBERT W. FENTZ, JR. ^{OWNER} _{DISTRIBUTOR}

DATE INSPECTED: NOV 6, 1980 INSPECTORS: JERRY SASEEN

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME: _____

ADDRESS: _____

PHONE: _____ FAC. REP. _____

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: _____ DATE PLAN REQ'D: _____

OIL STORAGE CAPACITY ABOVEGROUND: 45000 GALLONS
UNDERGROUND: 6000 GALLONS

SPCC PLAN PREPARED: Y (Y/N) AVAILABLE FOR REVIEW: Y (Y/N)

DATE CERTIFIED: _____ SEAL AFFIXED: Y (Y/N)

ENGINEER: WILLIAM L. WEAVER LICENSE #: 8911-F STATE: PA

FAC. RECORD OF REVIEW OF PLAN EVERY THREE YEARS: _____ (Y/N)

DATES OF REVIEW: _____

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: Y (Y/N)

TWO SPILLS IN PAST 12 MONTHS: Y (Y/N)

SPCCDATA.

ORIGINAL
(Red)

SPCC PLAN INSPECTION

A. Facility Name UNITED REFINERY COMPANY
Address 2318 West State Street
New Castle, PA. 16101
(Zip)
Telephone No. 412-658-5557
Contact: Robert W. Fentz, Jr. Title: Owner Distributor

B. Has an SPCC Plan been prepared? Yes X No
Has an SPCC Plan been implemented? Yes X No
Has it been certified by a Registered Professional Engineer? Yes X No

Name William L. Wagner No. 8911-F State PA

C. Closest water body Shenengo River Distance 2 miles

D. Facility start-up date New owner Dec. 1978

E. Storage:	Underground (X)	Above Ground (X)	Product
2		15,000 Gallons	Fuel Oil
2		15,000 "	Gasoline
1		15,000 "	Kerosene
1	6,000 gallons		Fuel Oil

F. Comments: (Home Office, recent spills, etc.)

The SPCC plan appears to conform to the requirements of Title 40 Code of Federal Regulation, Part 112.

Inspected by Jerry Saseen
Date 11/6/80

"I certify the above to be accurate to the best of my knowledge".


Company Official _____

NORTHWEST ENGINEERING inc.

ORIGINAL
(Red)

BY: WLW DATE: 7.1.74 SUBJECT: NEW CASTLE BULK JOB NO. _____

CK: _____ DATE: _____ PLANT PAGE _____ OF _____

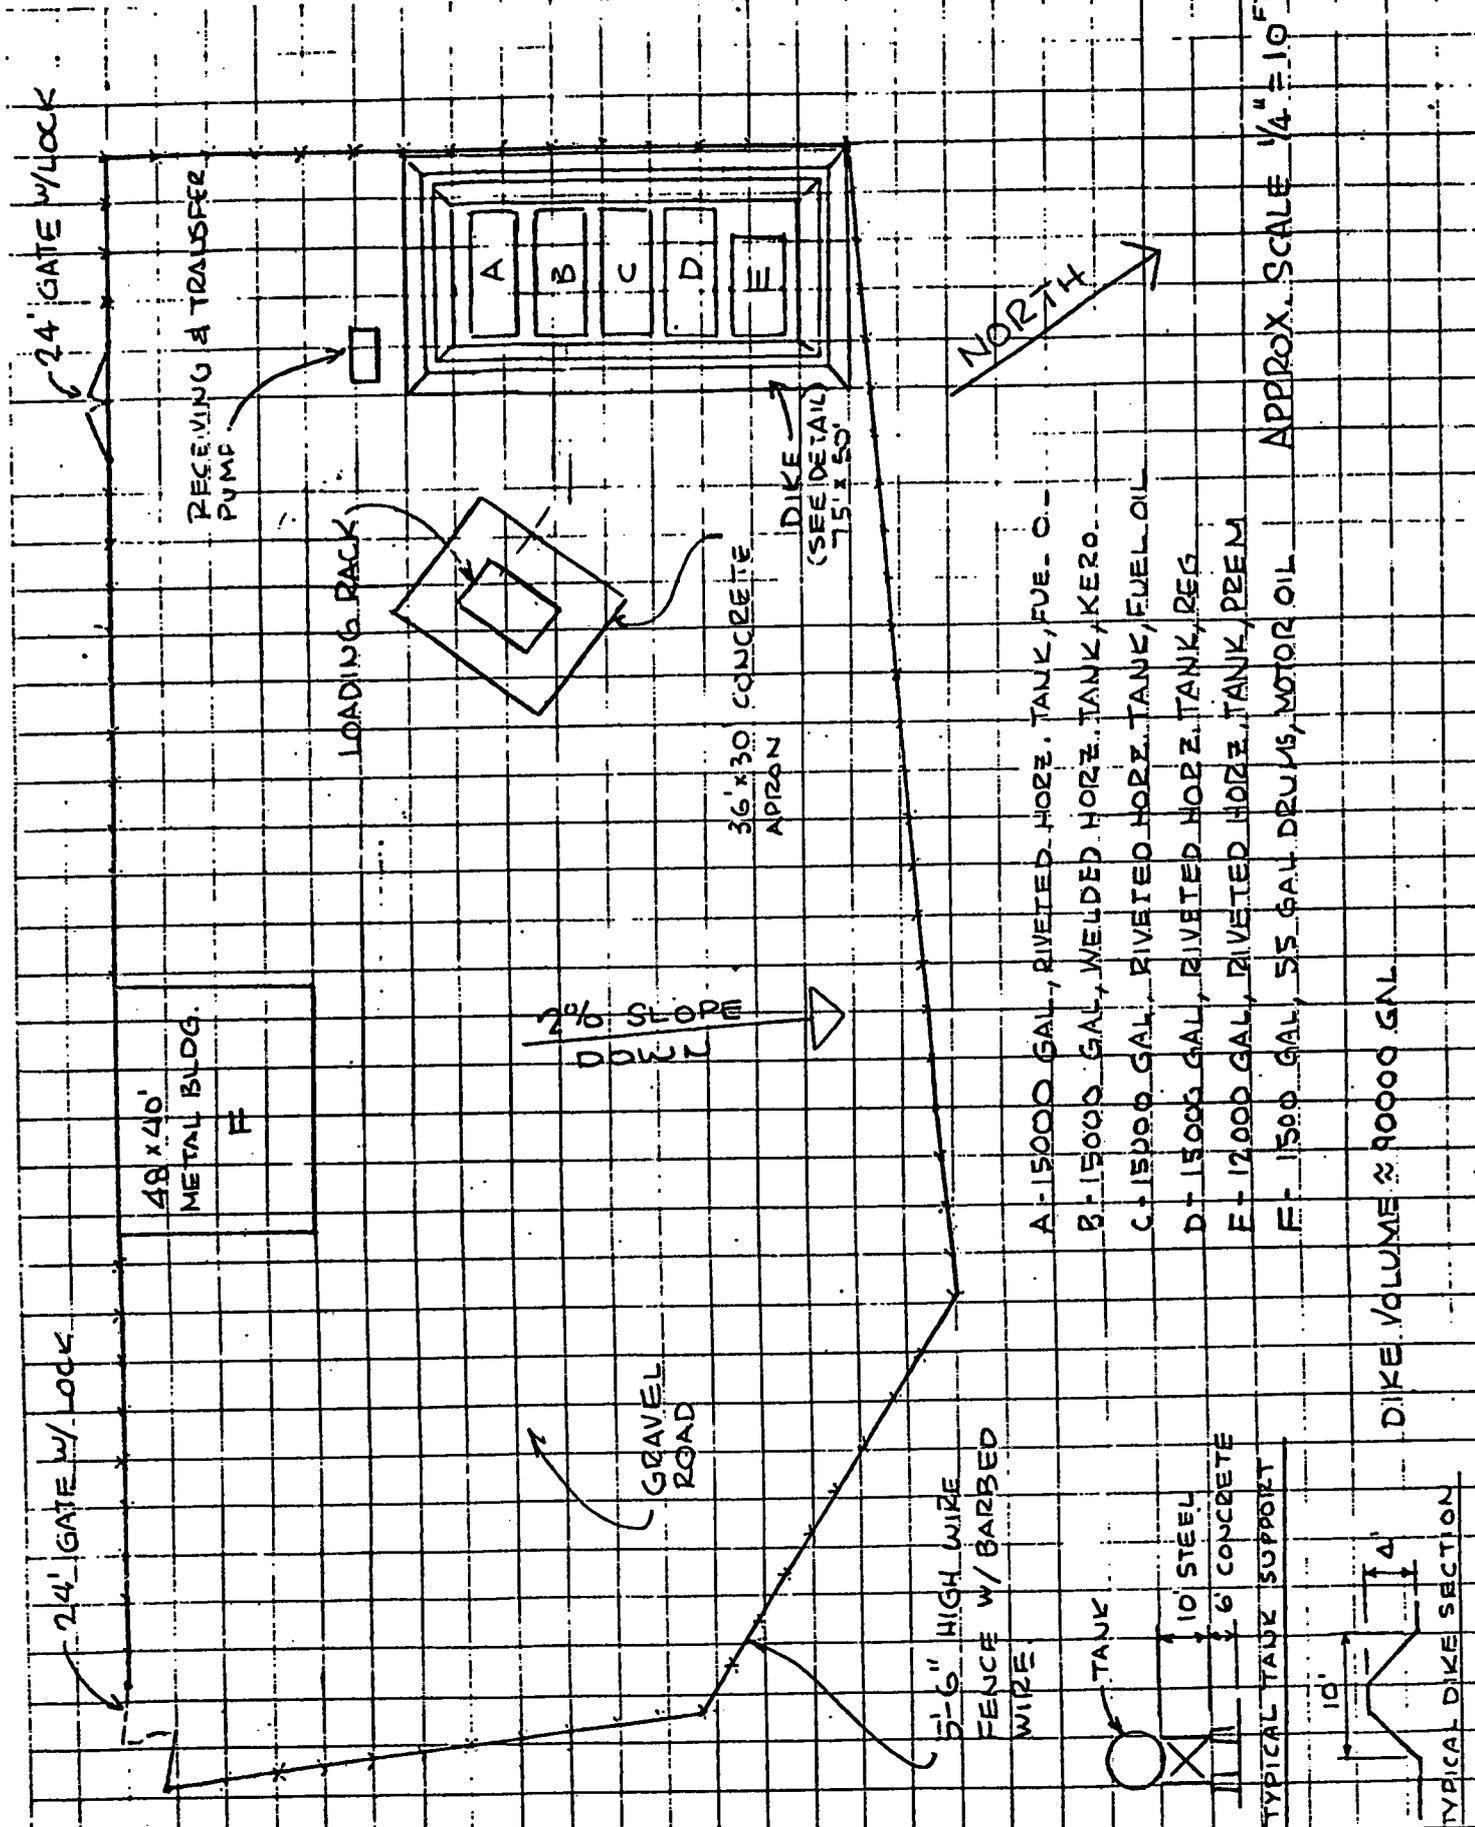

- A-15000 GAL., RIVETED HORIZ. TANK, FUEL OIL
- B-15000 GAL., WELDED HORIZ. TANK, KERO.
- C-15000 GAL., RIVETED HORIZ. TANK, FUEL OIL
- D-15000 GAL., RIVETED HORIZ. TANK, REG.
- E-12000 GAL., RIVETED HORIZ. TANK, PREM.
- F-1500 GAL., 55 GAL DRUMS, MOTOR OIL

APPROX. SCALE 1/4" = 10' FT

DIKE VOLUME ≈ 90000 GAL.

NW 3

181

10/11/92

ORIGINAL
(Rec)

SPCC INSPECTION DATABASE

CASE # : PA-81-017

DATE OF TARGET: _____

FACILITY NAME: UNITED REFINING CO. - GALLATIN OIL CO.

ADDRESS: RD 1 - LEMONT FURNACE, SUMMERSVILLE RD.
UNIONTOWN, PA. 15456

COUNTY: FAYETTE

TARGET BY: _____

PHONE: 412-438-5445

FAC. REP. ROCKWILL, PRESIDENT

DATE INSPECTED: JAN 28, 1981

INSPECTORS: JERRY SASEEN

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME: _____

ADDRESS: _____

PHONE: _____

FAC. REP. _____

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: _____

DATE PLAN REQ'D: _____

OIL STORAGE CAPACITY ABOVEGROUND: _____

GALLONS

UNDERGROUND: _____

GALLONS

SPCC PLAN PREPARED: ___ (Y/N)

AVAILABLE FOR REVIEW: ___ (Y/N)

DATE CERTIFIED: _____

SEAL AFFIXED: ___ (Y/N)

ENGINEER: _____

LICENSE #: _____

STATE: _____

FAC. RECORD OF REVIEW OF PLAN EVERY THREE YEARS: ___ (Y/N)

DATES OF REVIEW: _____

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: ___ (Y/N)

TWO SPILLS IN PAST 12 MONTHS: ___ (Y/N)

SPCCDATA.

SPPG PLAN INSPECTION

ORIGINAL
(Red)

A. Facility Name United Refining Company - Gallatin Oil Company

Address RD 1 - Lemont Furnace, Jumomville Rd.

Uniontown, PA. 15456
(Zip)

Telephone No. 412-438-5445

Contact: Rock Coville Title: President

B. Has an SPPG Plan been prepared? Yes X No

Has an SPPG Plan been implemented? Yes X No

Has it been certified by a Registered Professional Engineer? Yes X No

Name William L. Wagner No. 8911-2 State PA

C. Closest water body Trib. to Red Stone Creek Distance 50'

D. Facility start-up date 1974

E. Storage:	Underground (X)	Above Ground (X)	Product
4		12,000 Gallons	Kerosene
1		7,000 Gallons	Fuel Oil
1		20,000 gallons	Gasoline
1	550 gallons		Gasoline

F. Comments: (Home Office, recent spills, etc.)

Company found to be in compliance. Plan was reviewed and conditions at facility were good.

Inspected by Jerry Saseen

Date 1/28/81

ORIGINAL
(Red)

SPCC Inspection REPORT

CASE # : VA-79-004

DATE OF TARGET:

FACILITY NAME: D.S.BUCK, INC.; TEXACO, INC

ADDRESS: 356 WEST MAIN STREET
ABINGDON,

VA

COUNTY: WASHINGTON

TARGET BY:

PHONE: (703)628-2933

FAC. REP.: BOB CAMPBELL
TITLE: ASSTT. MANAGER

DATE INSPECTED: 10/12/78

INSPECTORS: BENTON M. WILMOTH

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:

ADDRESS:

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE:

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND:
UNDERGROUND:

56,800GALLONS
GALLONS

SPCC PLAN PREPARED: Y

AVAILABLE FOR REVIEW: Y

DATE CERTIFIED:

SEAL AFFIXED: Y

ENGINEER: ALBERT M. LUNTE LICENSE #:2401

STATE: WV

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS: N
DATES OF REVIEW:

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS:
TWO SPILLS IN PAST 12 MONTHS:

COMMENTS:

SPCC INSPECTION DATABASE

CASE # : VA-79-004 DATE OF TARGET: _____

FACILITY NAME: D.S. BIRK, INC. TEXACO, INC.

ADDRESS: 356 W. MAIN - SIDEET

ABINGDON, VIRGINIA 24210

COUNTY: WASHINGTON TARGET BY: _____

PHONE: 703-628-2933 FAC. REP. BOB CAMPBELL, ASST. MGR

DATE INSPECTED: OCT. 12, 1978 INSPECTORS: BENJEN WILMOTH

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME: _____

ADDRESS: _____

PHONE: _____ FAC. REP. _____

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: _____ DATE PLAN REQ'D: _____

OIL STORAGE CAPACITY ABOVEGROUND: 56,800 GALLONS
UNDERGROUND: _____ GALLONS

SPCC PLAN PREPARED: Y (Y/N) AVAILABLE FOR REVIEW: Y (Y/N)

DATE CERTIFIED: _____ SEAL AFFIXED: Y (Y/N)

ENGINEER: ALBERT M. LUNTER LICENSE #: 2401 STATE: W.V.

FAC. RECORD OF REVIEW OF PLAN EVERY THREE YEARS: _____ (Y/N)

DATES OF REVIEW: _____

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: _____ (Y/N)

TWO SPILLS IN PAST 12 MONTHS: _____ (Y/N)

SPCCDATA.

SPCC PLAN INSPECTION

ORIGINAL
(Red)

A. Facility Name D. S. BUCK, INC. TEXACO, INC.
 Address 356 W. MAIN STREET
ARLINGTON, VIRGINIA 24210
 Telephone No. 703/628-2933
 Contact Bob Campbell Title Assistant Manager

B. Has an SPCC Plan been prepared? Yes x No
 Has an SPCC Plan been implemented? Yes x No
 Has it been certified by a Registered Professional Engineer? Yes x No
 Name Albert M. Lunter No. 2401 State W. Va.

C. Closest water body Herts Creek Distance 4,000 feet

D. Facility start-up date _____

E. Storage:	<u>Underground ()</u>	<u>Above Ground (x)</u>	<u>Product</u>
12,800 gal.	aboveground tank		gasoline
9,000 gallon	aboveground tank		gasoline
12,000 gallon	aboveground tank		gasoline
12,000 gallon	aboveground tank		fuel oil
8,000 gallon	aboveground tank		kerosene
3,000 gallon	aboveground tank		fuel oil

F. Comments: (Home Office, Recent Spills, etc.)

Inspected by BENTON WILMOTH

Date October 12, 1978

ORIGINAL
(Red)

WV-75-052NC

SPCC PLAN INSPECTION

Facility name J. C. Baker and Sons

Address Texaco Distributor facility at Summersville, W. Va.

601-A Elk St., Gassaway, W. Va. 26624 BRAXTON COUNTY

Telephone No. 304-364-5114

Has an SPCC Plan been prepared? Yes _____ No X

Has it been certified by a Registered-Professional-Engineer? Yes _____ No _____

Name of person contacted: J. C. Baker, Distributor

Means of contact: At facility X Nearest Office X

Telephone _____ Other _____

Comments:

The Texaco Products storage facility at Summersville, W. Va. is owned by J. C. Baker. Mr. Baker was interviewed at his office in Gasaway, W. Va.. Mr. Baker said that he was unaware of the Federal regulations requiring SPCC plans, therefore he had no plan. He would like to receive a copy of the regulations.

Regs. sent on 4-8-75
Letter in file.

Inspected by Benton Wilmoth
Wheeling Field Office

Date: April 4, 1975

Time: 1340 at Summersville, W. Va-

1420 at Gassaway, W. Va.

SPCC PLAN INSPECTION

WV-75-059NC

Facility name Burkhart Oil Company, Inc., Gulf Oil Distributor

Address 1316 North Queen St.

Martinsburg, WV 25401 BERKELEY COUNTY

Telephone No. 304-267-8947

Has an SPCC Plan been prepared? Yes _____ No X

Has it been certified by a Registered Professional Engineer? Yes _____ No X

Name of person contacted: Gail W. Updike - Jobber

Means of contact: At facility X Nearest Office _____

Telephone _____ Other _____

Comments:

Total storage of oil, gasoline, and diesel fuel is about 302,000 gallon, all of which is above ground. Mr. Updike said that an engineering firm is presently preparing an SPCC plan for this facility. The firm is known as Environmental Energy Engineering, Inc. of Morgantown, W. Va.

Inspected by Benton Wilmoth

Wheeling Field Office

Date: April 24, 1975

Time: 1045

ORIGINAL
(Red)

SPCC Inspection REPORT

CASE # : WV-75-061N

DATE OF TARGET:

FACILITY NAME: HUTZLER OIL CO., ARCO DEALER

ADDRESS: WILLIAMS AND BALTIMORE STREETS
MARTINSBURG, WV

COUNTY: BERKELEY

TARGET BY:

PHONE: (304)263-8927

FAC. REP.: LOUISE STILWELL
TITLE: OFFICE MANAGER

DATE INSPECTED: 04/24/75

INSPECTORS: BENTON M. WILMOTH

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:
ADDRESS:

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE:

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND:
UNDERGROUND:

80,000GALLONS
4,100GALLONS

SPCC PLAN PREPARED: Y

AVAILABLE FOR REVIEW: Y

DATE CERTIFIED:

SEAL AFFIXED:

ENGINEER:

LICENSE #:

STATE:

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS:
DATES OF REVIEW:

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS:
TWO SPILLS IN PAST 12 MONTHS:

COMMENTS:

SPCC Inspection REPORT

CASE # : WV-75-062N

DATE OF TARGET:

FACILITY NAME: R.M.ROACH&SONS,INC-TEXACO DIST

ADDRESS: 333 EAST JOHN ST.
MARTINSBURG,

WV

COUNTY: BERKELEY

TARGET BY:

PHONE: (304)263-3329

FAC. REP.: DOUG ROACH
TITLE: PLANT MANAGER

DATE INSPECTED: 04/24/75

INSPECTORS: BENTON M. WILMOTH

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:
ADDRESS:

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE:

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND:

89,000GALLONS

UNDERGROUND:

GALLONS

SPCC PLAN PREPARED: N

AVAILABLE FOR REVIEW: N

DATE CERTIFIED:

SEAL AFFIXED:

ENGINEER:

LICENSE #:

STATE:

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS:

DATES OF REVIEW:

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS:

TWO SPILLS IN PAST 12 MONTHS:

COMMENTS:

SPCC PLAN INSPECTION

WV-75-062 NC

Facility name R. M. Roach and Sons, Inc., Texaco Distributor

Address 333 East John St.

Martinsburg, W. Va. 25401 BERKELEY COUNTY

Telephone No. 304-263-3329

Has an SPCC Plan been prepared? Yes _____ No X

Has it been certified by a Registered Professional Engineer? Yes _____ No X

Name of person contacted: Doug Roach, Plant Manager

Means of contact: At facility _____ Nearest Office _____

Telephone X Other _____

Comments:

The total above ground storage of Texaco petroleum products is 89,000 gallons. Mr. Roach was called by Mr. Updike of Burkhart Oil Company and told of the EPA inspections of SPCC plans. Mr. Roach said that an SPCC plan was being prepared for this facility by Environmental, Energy Engineering, Inc. of Morgantown, W. Va. He did not indicate the amount of time for completion of the plan.

Inspected by Benton Wilmoth

Date: 4-24-75

Time: 1130

SPCC Inspection REPORT

CASE # : WV-75-063

DATE OF TARGET:

FACILITY NAME: SHENANDOAH OIL CO., SUNOCO PROD

ADDRESS: 640 WEST RACE STREET
MARTINSBURG,

WV

COUNTY: BERKELEY

TARGET BY:

PHONE: (304)263-1811

FAC. REP.: MR. JAMES BARNES
TITLE: MGR. SERV. DEPT

DATE INSPECTED: 04/24/75

INSPECTORS: BENTON M. WILMOTH

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:

ADDRESS:

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE:

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND:

GALLONS

UNDERGROUND:

80,000GALLONS

SPCC PLAN PREPARED: Y

AVAILABLE FOR REVIEW: Y

DATE CERTIFIED:

SEAL AFFIXED:

ENGINEER: WILLIS K. BISHO LICENSE #:

STATE:

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS:

DATES OF REVIEW:

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS:

TWO SPILLS IN PAST 12 MONTHS:

COMMENTS:

SPCC PLAN INSPECTION

WV-75-063

Facility name Shenandoah Oil Company, Sunoco Products

Address 640 West Race St.

Martinsburg, W. Va. 25401 BERKELEY COUNTY

Telephone No. 304-263-1811

Has an SPCC Plan been prepared? Yes X No

Has it been certified by a Registered Professional Engineer? Yes X No

Name of person contacted: Mr. James Barnes, Mgr. Service Department

Means of contact: At facility x Nearest Office

Telephone Other

Comments:

Mr. Barnes said that the total below ground storage is 80,000 gallon. An SPCC plan is prepared for the plant and has been certified by Willis K. Bishop, Registered Professional Engineer.

Inspected by Benton Wilmoth

Wheeling Field Office

Date: April 24, 1975

Time: 1430

ORIGINAL
(Red)

SPCC Inspection REPORT

CASE # : WV-75-067

DATE OF TARGET:

FACILITY NAME: WOODFORD OIL CO., GULF DISTRIB

ADDRESS: 13th & LIVINGSTON AVE.
ELKINS,

WV

COUNTY: RANDOLPH

TARGET BY:

PHONE: (304) 636-2688

FAC. REP.: C. W. WOODFORD
TITLE: OWNER

DATE INSPECTED: 05/08/75

INSPECTORS: RICHARD W. FULLNER

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME: WOODFORD OIL CO., GULF DISTRIB
ADDRESS: P. O. BOX 597
ELKINS,

WV

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE:

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND:
UNDERGROUND:

144,000 GALLONS
GALLONS

SPCC PLAN PREPARED: Y

AVAILABLE FOR REVIEW: Y

DATE CERTIFIED:

SEAL AFFIXED:

ENGINEER:

LICENSE #:

STATE:

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS:
DATES OF REVIEW:

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS:
TWO SPILLS IN PAST 12 MONTHS:

COMMENTS:

SPCC PLAN INSPECTION

WV-75-067

Facility name Woodford Oil Company -- Gulf Distributor

Address 13th and Livingston Avenue (P. O. Box 597)

Elkins, West Virginia 26241 RANDOLPH COUNTY

Telephone No. 304-636-2688

Has an SPCC Plan been prepared? Yes X No

Has it been certified by a Registered Professional Engineer? Yes X No

Name of person contacted: C. W. Woodford
Owner

Means of contact: At facility X Nearest Office

Telephone Other

Comments:

Total storage capacity is about 144,000 gallons.

Plan appears adequate.

Inspected by Richard W. Fullner

Wheeling Field Office

Date: 5-8-75

Time: 1600

ORIGINAL
(Red)

SPCC Inspection REPORT

CASE # : WV-75-070N

DATE OF TARGET:

FACILITY NAME: D & H OIL COMPANY - ARCO

ADDRESS: P. O. BOX 490
BRIDGEPORT,

WV

COUNTY: HARRISON

TARGET BY:

PHONE: (304)265-0379

FAC. REP.: ROSE DUKE
TITLE:

DATE INSPECTED: 05/08/75

INSPECTORS: RICHARD W. FULLNER

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:

ADDRESS:

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE:

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND:

GALLONS

UNDERGROUND:

GALLONS

SPCC PLAN PREPARED: N

AVAILABLE FOR REVIEW: N

DATE CERTIFIED:

SEAL AFFIXED:

ENGINEER:

LICENSE #:

STATE:

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS:

DATES OF REVIEW:

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS:

TWO SPILLS IN PAST 12 MONTHS:

COMMENTS: * THE FACILITY HAS AN ESTIMATED 40,000 GALLONS OF ABOVE
GROUND STORAGE. THE FACILITY IS LOCATED ON COUNTRY CLUB
ROAD IN GRAFTON, WEST VIRGINIA.

WV-75-070NC

SPCC PLAN INSPECTION

ORIGINAL
(Red)

Facility name D & H Oil Company - ARCO*

Address P. O. Box 490

Bridgeport, West Virginia 26330 HARRISON COUNTY

Telephone No. 304-265-0379

Has an SPCC Plan been prepared? Yes _____ No X

Has it been certified by a Registered Professional Engineer? Yes _____ No X

Name of person contacted: Rose Duke

Means of contact: At facility X Nearest Office _____

Telephone X Other _____

Comments:

No one was at the facility at the time of my visit. I called back on 5-12-75 and was informed that they were not aware of the regulations. I sent a copy by mail.

NOTE: The facility has an estimated 40,000 gallons of above ground storage.
* The facility is located on Country Club Road in Grafton, West Virginia.

Inspected by Richard W. Fullner

Wheeling Field Office

Date: 5-8-75

Time: 1300

RECORD OF TELEPHONE CALL

DATE : 6-5-75 TIME: 1400 FILE NO. _____

FROM : Patrick Deem, Atty, O+ H Oil Co.

TO : Fullner

SUBJECT: SPCC violation.

REMARKS:

Mr. Deem called concerning a violation notice they had received. He said that ARCO owns the facility & product & that they merely transport it on a commission basis.

I suggested that he direct a letter to Enforcement explaining their position.

ACTION REQUIRED:

Fullner
Signature

ORIGINAL
(Red)

SPCC Inspection REPORT

CASE # : WV-75-072N

DATE OF TARGET:

FACILITY NAME: HAMRICK OIL COMPANY - ARCO

ADDRESS: 11th & BAKER STREETS
ELKINS,

WV

COUNTY: RANDOLPH

TARGET BY:

PHONE: (304) 636-3677

FAC. REP.: NAOMI HAMRICK
TITLE: OFFICE MANAGER

DATE INSPECTED: 05/08/75

INSPECTORS: RICHARD W. FULLNER

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME: HAMRICK OIL COMPANY - ARCO
ADDRESS: P. O. BOX 390
ELKINS,

WV

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE:

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND:
UNDERGROUND:

37,000 GALLONS
GALLONS

SPCC PLAN PREPARED: N

AVAILABLE FOR REVIEW: N

DATE CERTIFIED:

SEAL AFFIXED:

ENGINEER:

LICENSE #:

STATE:

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS:
DATES OF REVIEW:

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS:
TWO SPILLS IN PAST 12 MONTHS:

COMMENTS:

SPCC PLAN INSPECTION

ORIGINAL
(Red)

NV-75-072NC

Facility name Hamrick Oil Company - ARCO

Address 11th & Baker Street (P. O. Box 390)

Elkins, Rest Virginia 26241

PANDOLPH COUNTY

Telephone No. 304-636-3677

Has an SPCC Plan been prepared? Yes _____ No X

Has it been certified by a Registered Professional Engineer? Yes _____ No X

Name of person contacted: Naomi Hamrick
Office Manager

Means of contact: At facility X Nearest Office _____

Telephone X Other _____

Comments:

Mrs. Hamrick could not locate a plan. She said she would check on it and contact me. On 5-12-75 I received a letter from Mrs. Hamrick suggesting that I call Mr. Harold McHail of ARCO in Pittsburgh (412-562-1961). I contacted Mr. McHail on 5-14-75. He said he thought a plan had been prepared and he would call back.

On 5-14-75, Mr. Steven Wolf, lawyer for ARCO, called back and said there apparently had been no preparation of a plan for the facility. Mr. Wolf indicated that they might contest the need for a plan on the basis of section 112.1 (a) (4).

Total storage capacity at the facility is 37,000 gallons.

Inspected by Richard W. Fullner
Wheeling Field Office

Date: 5-8-75

Time: 1630

ORIGINAL
(Red)

SPCC Inspection REPORT

CASE # : WV-75-074N

DATE OF TARGET:

FACILITY NAME: HESS OIL CO., PHILLIPS 66

ADDRESS: P.O. BOX 465, (RT. 219 N.)
ELKINS, WV

COUNTY: RANDOLPH

TARGET BY:

PHONE: (304) 636-2811

FAC. REP.:
TITLE:

DATE INSPECTED: 05/09/75

INSPECTORS: RICHARD W. FULLNER

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:

ADDRESS:

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE:

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND:

GALLONS

UNDERGROUND:

GALLONS

SPCC PLAN PREPARED: N

AVAILABLE FOR REVIEW: N

DATE CERTIFIED:

SEAL AFFIXED:

ENGINEER:

LICENSE #:

STATE:

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS:

DATES OF REVIEW:

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS:

TWO SPILLS IN PAST 12 MONTHS:

COMMENTS:

WV-75-074NC

SPCC PLAN INSPECTION

ORIGINAL
(Red)

Facility name Hess Oil Company - Phillips 66

Address P. O. Box 465 (Rt. 219 N.)

Elkins, West Virginia 26241 RANDOLPH COUNTY

Telephone No. 304-636-2811

Has an SPCC Plan been prepared? Yes _____ No x

Has it been certified by a Registered Professional Engineer? Yes _____ No X

Name of person contacted:

Means of contact: At facility x Nearest Office _____

Telephone _____ Other _____

Comments:

Mrs. Skidmore could not locate the plan. I will call back and contact Mr. Ralph Hess, Terminal Manager to see if they have a plan.

I contacted Mr. Hess on 5-14-75. They do not have a plan but he indicated he would get moving on it immediately.

Inspected by Richard W. Fullner

Wheeling Field office

Date: 5-9-75

Time: 0845

ORIGINAL
(Red)

SPCC Inspection REPORT

CASE # : WV-75-076N

DATE OF TARGET:

FACILITY NAME: W.A. SCHEEL, INC., TEXACO DISTR

ADDRESS: U.S. 250 & 219 S.
ELKINS,

WV

COUNTY: RANDOLPH

TARGET BY:

PHONE: (304) 636-2600

FAC. REP.: A. P. VARCHETTO
TITLE: TERNINAL MGR.

DATE INSPECTED: 05/09/75

INSPECTORS: RICHARD W. FULLNER

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:
ADDRESS:

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE:

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND:

GALLONS

UNDERGROUND:

200,000GALLONS

SPCC PLAN PREPARED: Y

AVAILABLE FOR REVIEW: N

DATE CERTIFIED:

SEAL AFFIXED:

ENGINEER:

LICENSE #:

STATE:

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS:

DATES OF REVIEW:

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS:

TWO SPILLS IN PAST 12 MONTHS:

COMMENTS:

ORIGINAL
(Red)

WV-75-076NC

SPCC PLAN INSPECTION

Facility name W. A. Scheel, Inc. Texaco Distributors
Address U.S. 250 & 219 S.
Elkins, West Virginia RANDOLPH COUNTY
Telephone No. 304-636-2600

Has an SPCC Plan been prepared? Yes X No

Has it been certified by a Registered Professional Engineer? Yes No X

Name of person contacted: A.P. Varchetto
Terminal Manager

Means of contact: At facility X Nearest Office
Telephone Other

Comments:

Total storage capacity is 200,000 gallons, all underground.

The plan was prepared by Texaco Engineers out of Columbus, Ohio. The plan was not signed by an engineer but is in the process of being certified.

This facility is new, and began operating in August of 1974.

Inspected by Richard W. Fullner
Wheeling Field Office

Date: 5-9-75

Time: 0815

SPCC Inspection REPORT

CASE # : WV-76-008E

DATE OF TARGET:

FACILITY NAME: DAWSON OIL CO., INC. (ARCO)

ADDRESS: 4547 SIDERS AVE.
HUNTINGTON,

WV

COUNTY: CABELL

TARGET BY:

PHONE: (304)523-3511

FAC. REP.: P. BROWN

TITLE: OFFICE MANAGER

DATE INSPECTED: 04/14/76

INSPECTORS: R. W. SCHRECONGOST

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME: DAWSON OIL CO., INC. (ARCO)

ADDRESS: P. O. BOX 5583
HUNTINGTON,

WV

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE:

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND:

GALLONS

UNDERGROUND:

40,000GALLONS

SPCC PLAN PREPARED: N

AVAILABLE FOR REVIEW: N

DATE CERTIFIED:

SEAL AFFIXED: N

ENGINEER:

LICENSE #:

STATE:

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS:

DATES OF REVIEW:

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N

TWO SPILLS IN PAST 12 MONTHS: N

COMMENTS:

SPCC Inspection REPORT

CASE # : WV-76-008^E DATE OF TARGET:
FACILITY NAME: DAWSON OIL CO. INC (ARCO)
ADDRESS: 4547 SIDERS AVE, (PO BOX 5583)
HUNTINGTON, WV
COUNTY: CABELL TARGET BY:
PHONE: (304)523-3511 FAC. REP.: P. BROWN
TITLE: OFFICE MGR.
DATE INSPECTED: 04/14/76 INSPECTORS: R.W. SCHRECONGOST
OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):
NAME:
ADDRESS:
PHONE: FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: DATE PLAN REQ'D:
OIL STORAGE CAPACITY ABOVEGROUND: GALLONS
UNDERGROUND: 40,000GALLONS
SPCC PLAN PREPARED: N AVAILABLE FOR REVIEW: N
DATE CERTIFIED: SEAL AFFIXED: N
ENGINEER: LICENSE #: STATE:
FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS:
DATES OF REVIEW:
SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N
TWO SPILLS IN PAST 12 MONTHS: N

COMMENTS:

SPCC INSPECTION DATABASE

CASE # : WV-76-008 DATE OF TARGET: _____

FACILITY NAME: DAWSON OIL CO., INC. (ARCO)

ADDRESS: 4547 SIDERS AVE (PO. BOX 5583)
HUNTINGTON, WV. 25703

COUNTY: CABELL TARGET BY: _____

PHONE: 304-523-3511 FAC. REP. Ms P BROWN, OFFICE MGR.

DATE INSPECTED: APRIL 14, 1976 INSPECTORS: P.W. SCHRECONOST

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME: _____

ADDRESS: _____

PHONE: _____ FAC. REP. _____

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: _____ DATE PLAN REQ'D: _____

OIL STORAGE CAPACITY ABOVEGROUND: _____ GALLONS
UNDERGROUND: 4000 GALLONS

SPCC PLAN PREPARED: N (Y/N) AVAILABLE FOR REVIEW: N (Y/N)

DATE CERTIFIED: _____ SEAL AFFIXED: N (Y/N)

ENGINEER: _____ LICENSE #: _____ STATE: _____

FAC. RECORD OF REVIEW OF PLAN EVERY THREE YEARS: _____ (Y/N)

DATES OF REVIEW: _____

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N (Y/N)

TWO SPILLS IN PAST 12 MONTHS: N (Y/N)

SPCCDATA.

SPCC Inspection REPORT

CASE # : WV-76-009

DATE OF TARGET:

FACILITY NAME: GULF - HUNTINGTON TERMINAL

ADDRESS: 4602 OHIO RIVER ROAD
HUNTINTON,

WV

COUNTY: CABELL

TARGET BY:

PHONE: (304)525-5167

FAC. REP.: J.L. HUNT

TITLE: TERMINAL MGR.

DATE INSPECTED: 04/14/76

INSPECTORS: R. W. SCHDECONGOST

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:

ADDRESS:

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE:

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND:

83,752GALLONS

UNDERGROUND:

GALLONS

SPCC PLAN PREPARED: Y

AVAILABLE FOR REVIEW: Y

DATE CERTIFIED:

SEAL AFFIXED: Y

ENGINEER: JOHN W. STORB

LICENSE #:3194

STATE: WV

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS:

DATES OF REVIEW:

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N

TWO SPILLS IN PAST 12 MONTHS: N

COMMENTS:

SPCC INSPECTION DATABASE

CASE # : WV-76-009 DATE OF TARGET: _____
FACILITY NAME: GULF OIL CO - HUNTINGTON TERMINAL
ADDRESS: PO BOX 3086 (4602 OHIO R.D.)
HUNTINGTON, W.V. 25702
COUNTY: CABELL TARGET BY: _____
PHONE: 304-525-5167 FAC. REP. J. J. HUNT, TERMINAL MGR.
DATE INSPECTED: APRIL 14, 1976 INSPECTORS: R. W. SCHRECKENOST

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME: _____
ADDRESS: _____
PHONE: _____ FAC. REP. _____

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: _____ DATE PLAN REQ'D: _____
OIL STORAGE CAPACITY ABOVEGROUND: 23,752 GALLONS
UNDERGROUND: _____ GALLONS
SPCC PLAN PREPARED: Y (Y/N) AVAILABLE FOR REVIEW: Y (Y/N)
DATE CERTIFIED: _____ SEAL AFFIXED: Y (Y/N)
ENGINEER: John W. Storb LICENSE #: 3194 STATE: W.V.
FAC. RECORD OF REVIEW OF PLAN EVERY THREE YEARS: _____ (Y/N)
DATES OF REVIEW: _____
SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N (Y/N)
TWO SPILLS IN PAST 12 MONTHS: N (Y/N)

SPCCDATA.

SPCC Inspection REPORT

CASE # : WV-76-017E

DATE OF TARGET:

FACILITY NAME: SUTPHIN & SON - GULF PRODUCTS

ADDRESS: RT 4 - P. O. BOX 1113
PRINCETON,

WV

COUNTY: MERCER

TARGET BY:

PHONE: (304)425-9014

FAC. REP.: CHARLES SUTPHIN
TITLE: OWNER

DATE INSPECTED: 06/10/76

INSPECTORS: BENTON M. WILMOTH

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:
ADDRESS:

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE:

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND:

GALLONS

UNDERGROUND:

20,000GALLONS

SPCC PLAN PREPARED: N

AVAILABLE FOR REVIEW: N

DATE CERTIFIED:

SEAL AFFIXED: N

ENGINEER:

LICENSE #:

STATE:

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS:
DATES OF REVIEW:

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N
TWO SPILLS IN PAST 12 MONTHS: N

COMMENTS: NO SPCC PLAN NEEDED AT THIS FACILITY

SPCC INSPECTION DATABASE

CASE # : WV-76-017E DATE OF TARGET: _____
FACILITY NAME: SUTPHIN & SON - GULF PRODUCTS
ADDRESS: RT 4 BOX 1113
PRINCETON, WV 24740
COUNTY: MERCER TARGET BY: _____
PHONE: 304-425-9014 FAC. REP. CHARLES SUTPHIN, OWNER
DATE INSPECTED: JUNE 10, 1976 INSPECTORS: BENTON WILMOTH

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME: _____
ADDRESS: _____
PHONE: _____ FAC. REP. _____

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: _____ DATE PLAN REQ'D: _____
OIL STORAGE CAPACITY ABOVEGROUND: _____ GALLONS
UNDERGROUND: 20,000 GALLONS
SPCC PLAN PREPARED: (Y/N) AVAILABLE FOR REVIEW: (Y/N)
DATE CERTIFIED: _____ SEAL AFFIXED: (Y/N)
ENGINEER: _____ LICENSE #: _____ STATE: _____
FAC. RECORD OF REVIEW OF PLAN EVERY THREE YEARS: _____ (Y/N)
DATES OF REVIEW: _____
SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: (Y/N)
TWO SPILLS IN PAST 12 MONTHS: (Y/N)

SPCCDATA.

SPCC PLAN INSPECTION

A. Facility Name Sutphin & Son - Gulf Products
Address Rt. 4, Box 1113
Princeton, W. Va. 24740
(Zip)
Telephone No. 304-425-9014
Contact: Charles Sutphin Title: owner

B. Has an SPCC Plan been prepared? Yes _____ No
Has an SPCC Plan been implemented? Yes _____ No _____
Has it been certified by a Registered Professional Engineer? Yes _____ No _____

Name _____ No. _____ State _____

C. Closest water body _____ Distance _____

D. Facility start-up date _____

E. Storage: Underground () Above Ground () Product
Total of 20,000 gal. underground storage -- gasoline

F. Comments: (Home Office, recent spills, etc.)
No SPCC plan needed at this facility

Inspected by Benton Wilmoth
Date June 10, 1976

"I certify the above to be accurate to the best of my knowledge".

Company Official _____

SPCC Inspection REPORT

CASE # : WV-76-021

DATE OF TARGET:

FACILITY NAME: GULF OIL CORP. PRODUCTS

ADDRESS: P.O. BOX 1292
BECKLEY,

WV

COUNTY: RALEIGH

TARGET BY:

PHONE: (304)253-7386

FAC. REP.: ELIZABETH HEWITT
TITLE: CLERK

DATE INSPECTED: 08/06/76

INSPECTORS: BENTON M. WILMOTH

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:

ADDRESS:

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE:

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND:

GALLONS

UNDERGROUND:

205,000GALLONS

SPCC PLAN PREPARED: Y

AVAILABLE FOR REVIEW: Y

DATE CERTIFIED:

SEAL AFFIXED: Y

ENGINEER: T.W. HOWARD

LICENSE #:

STATE: WV

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS:

DATES OF REVIEW:

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS:

TWO SPILLS IN PAST 12 MONTHS:

COMMENTS:

SPCC INSPECTION DATABASE

CASE # : WV-76-021 DATE OF TARGET: _____

FACILITY NAME: GULF OIL CORP PRODUCTS

ADDRESS: PO Box 1292

BECKLEY, WV. 25801

COUNTY: RALEIGH TARGET BY: _____

PHONE: 304-253-7386 FAC. REP. ELIZABETH HEWITT, CLERK

DATE INSPECTED: AUG 6, 1976 INSPECTORS: BENTON WILNOTH

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME: _____

ADDRESS: _____

PHONE: _____ FAC. REP. _____

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: _____ DATE PLAN REQ'D: _____

OIL STORAGE CAPACITY ABOVEGROUND: 25,000 GALLONS
UNDERGROUND: _____ GALLONS

SPCC PLAN PREPARED: X (Y/N) AVAILABLE FOR REVIEW: X (Y/N)

DATE CERTIFIED: _____ SEAL AFFIXED: X (Y/N)

ENGINEER: T.W. Howard LICENSE #: _____ STATE: WV

FAC. RECORD OF REVIEW OF PLAN EVERY THREE YEARS: _____ (Y/N)

DATES OF REVIEW: _____

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N (Y/N)

TWO SPILLS IN PAST 12 MONTHS: N (Y/N)

SPCCDATA.

SPCC PLAN INSPECTION

A. Facility Name Gulf Oil Corp. Products
Address P.O. Box 1292
Beckley, W. Va. 25801
(Zip)

Telephone No. 304-253-7386

Contact: Elizabeth Hewitt Title: Clerk

- B. Has an SPCC Plan been prepared? Yes No
- Has an SPCC Plan been implemented? Yes No
- Has it been certified by a Registered Professional Engineer? Yes No

Name T. W. Howard No. _____ State W. Va.

C. Closest water body Whitestick Creek Distance 500 ft

D. Facility start-up date _____

E. Storage:	Underground ()	Above Ground (<input checked="" type="checkbox"/>)	Product
one	100,000 gal.		gasoline
four	15,000 gal.		gasoline
one	15,000 gal.		herosene
two	15,000 gal.		diesel fuel

F. Comments: (Home Office, recent spills, etc.)

Inspected by Benton Whitworth
Date Aug. 6, 1976

"I certify the above to be accurate to the best of my knowledge".

Company Official Elizabeth Hewitt

ORIGINAL
(Red)

SPCC Inspection REPORT

CASE # : WV-80-008

DATE OF TARGET:

FACILITY NAME: TEXACO, INC.

ADDRESS: 437 INDUSTRIAL AVE.
STAR CITY,

WV

COUNTY: MONONGALIA

TARGET BY:

PHONE: (304)599-1110

FAC. REP.: ROBERT RODEHEABER
TITLE: WAREHOUSEMAN

DATE INSPECTED: 09/11/80

INSPECTORS: JERRY SASEEN

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:

ADDRESS:

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: 1941

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND:

34,306GALLONS

UNDERGROUND:

2,000GALLONS

SPCC PLAN PREPARED: Y

AVAILABLE FOR REVIEW: N

DATE CERTIFIED:

SEAL AFFIXED: N

ENGINEER: DONALD E. RATLI LICENSE #:22530

STATE: OH

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS: N

DATES OF REVIEW:

SPELL HISTORY: 1000 GAL IN PAST 12 MONTHS:

TWO SPILLS IN PAST 12 MONTHS:

COMMENTS: Company was found to be in compliance with SPCC regulations.

FY '80

ORIGINAL
(Red)

SPCC INSPECTION DATABASE

CASE # : WV-80-008 DATE OF TARGET: _____

FACILITY NAME: TEXACO, INC.

ADDRESS: 437 INDUSTRIAL AVE.

STAR CITY, WV 2605

COUNTY: MONONGALIA TARGET BY: _____

PHONE: 304-599-1110 FAC. REP. ROBERT BODEHEBER, WAREHOUSEMAN

DATE INSPECTED: SEPT. 11, 1980 INSPECTORS: JERRY SASEEN

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME: _____

ADDRESS: _____

PHONE: _____ FAC. REP. _____

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: 1941 DATE PLAN REQ'D: _____

OIL STORAGE CAPACITY ABOVEGROUND: 34,306 GALLONS
UNDERGROUND: 2,000 GALLONS

SPCC PLAN PREPARED: Y (Y/N) AVAILABLE FOR REVIEW: ___ (Y/N)

DATE CERTIFIED: _____ SEAL AFFIXED: ___ (Y/N)

ENGINEER: DONALD F. PATLIEFF LICENSE #: 22530 STATE: OHIO

FAC. RECORD OF REVIEW OF PLAN EVERY THREE YEARS: ___ (Y/N)

DATES OF REVIEW: _____

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: ___ (Y/N)

TWO SPILLS IN PAST 12 MONTHS: ___ (Y/N)

SPCCDATA.

SPCC PLAN INSPECTION

ORIGINAL
(Red)

A. Facility Name TEXACO, INC.
 Address 437 INDUSTRIAL AVE.
STAR CITY, WV. 26505

Telephone No. 304-599-1110
 Contact Robert Rodeheaber

Title Warehouseman

B. Has an SPCC Plan been prepared? Yes X No _____
 Has an SPCC Plan been implemented? Yes X No _____
 Has it been certified by a Registered Professional Engineer? Yes X No _____
 Name Donald E. Ratliffe No. 22530 State Ohio

C. Closest water body Monongahela River Distance 700'

D. Facility start-up date 1941

Storage:	<u>Underground (x)</u>	<u>Above Ground (x)</u>	<u>Product</u>
2		400 bbl.	Empty
1		2,652 bbl.	Gasoline
1		7,880 bbl.	Diesel Fuel #2
1		5,984 bbl.	Diesel Fuel #2
1		1,020 bbl.	Gasoline
1		15,970 bbl.	Gasoline
1	2,000 gallon		Waste

F. Comments: (Home Office, Recent Spills, etc.)
 The company was found to be in compliance with the SPCC regulation

Inspected by Jerry Saseen
 Date September 11, 1980

ORIGINAL
(Red)

SPCC Inspection REPORT

CASE # : WV-83-004

DATE OF TARGET:

FACILITY NAME: BROCH OIL COMPANY (SUNOCO)

ADDRESS: RT. 7, P. O. BOX 55 F
MORGANTOWN, WV

COUNTY: MONONGALIA

TARGET BY:

PHONE: (304)296-7903

FAC. REP.: ANDREW OLESKA
TITLE: PRESIDENT

DATE INSPECTED: 12/09/82

INSPECTORS: JERRY SASEEN

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:
ADDRESS:

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: 1973

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND: 35,000GALLONS
UNDERGROUND: 5,500GALLONS

SPCC PLAN PREPARED: Y AVAILABLE FOR REVIEW: Y

DATE CERTIFIED: SEAL AFFIXED: Y

ENGINEER: ROBERT D. SHEET LICENSE #:4218 STATE: WV

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS:
DATES OF REVIEW:

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS:
TWO SPILLS IN PAST 12 MONTHS:

COMMENTS: COMPANY'S SPCC PLAN WAS FOUND TO BE IN COMPLIANCE WITH THE
SPCC REGULATIONS.

SPCC INSPECTION DATABASE

CASE # : WV-83-004 DATE OF TARGET: _____

FACILITY NAME: BACH OIL COMPANY (SUNOCO)

ADDRESS: RT. 7 Box 55F
MORGANTOWN, W.V. 26505

COUNTY: _____ TARGET BY: _____

PHONE: 34-26-703 FAC. REP. ANDREW OLEKSA, PRESIDENT

DATE INSPECTED: DEC. 2, 1982 INSPECTORS: JERRY JASEEN

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME: _____

ADDRESS: _____

PHONE: _____ FAC. REP. _____

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: 1973 DATE PLAN REQ'D: _____

OIL STORAGE CAPACITY ABOVEGROUND: 25,000 GALLONS
UNDERGROUND: 500 GALLONS

SPCC PLAN PREPARED: Y (Y/N) AVAILABLE FOR REVIEW: Y (Y/N)

DATE CERTIFIED: _____ SEAL AFFIXED: Y (Y/N)

ENGINEER: ROBERT D. SHEETS LICENSE #: 4218 STATE: WV

FAC. RECORD OF REVIEW OF PLAN EVERY THREE YEARS: _____ (Y/N)

DATES OF REVIEW: _____

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: _____ (Y/N)

TWO SPILLS IN PAST 12 MONTHS: _____ (Y/N)

SPCCDATA.

SPCC PLAN INSPECTION

A. Facility Name Broch Oil Company (Sunoco)
 Address Rt. 7, Box 55F
Morgantown, WV. 26505
 (Zip)
 Telephone No. 304-296-7903
 Contact: Andrew Oleksa Title: President

B. Has an SPCC Plan been prepared? Yes X No
 Has an SPCC Plan been implemented? Yes X No
 Has it been certified by a Registered Professional Engineer? Yes X No

Name Robert D. Sheets No. 4218 State WV.

C. Closest water body Decker-Creek Distance 40 ft.

D. Facility start-up date 1973

E. Storage:	Underground (X)	Above Ground (X)	Product
2		10,000 gallons	Gasoline
1		5,000 gallons	"
1		10,000 gallons	"
2	1,000 gallons		"
1	500 gallons		Fuel Oil
	3000		

F. Comments: (Home Office, recent spills, etc.)
 Company's SPCC plan was found to be in compliance with the SPCC regulations.

Inspected by Jerry Saseen
 Date 12-9-82

ORIGINAL
(Red)

SPCC Inspection REPORT

CASE # : PA-75-035

DATE OF TARGET:

FACILITY NAME: ARCO POLYMERS, INC.

ADDRESS: BEAVER VAL. PLNT-FRANKFORT RD.
MONACA, PA

COUNTY: BEAVER

TARGET BY:

PHONE: (412)774-1000

FAC. REP.: R.B. COUGHANOUR
TITLE: PH ENGINEER

DATE INSPECTED: 04/15/75

INSPECTORS: RICHARD W. FULLNER

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:
ADDRESS:

PHONE:

FAC. REP: J. E. GRANDE

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE:

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND: 1,000,000 GALLONS
UNDERGROUND: GALLONS

SPCC PLAN PREPARED: Y

AVAILABLE FOR REVIEW: Y

DATE CERTIFIED:

SEAL AFFIXED: Y

ENGINEER:

LICENSE #:

STATE:

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS:
DATES OF REVIEW:

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N
TWO SPILLS IN PAST 12 MONTHS: N

COMMENTS:

PA-75-035

SPCC PLAN INSPECTION

ORIGINAL
(Red)

Facility name ARCO Polymers Inc., Beaver Valley Plant

Address Frankfort Road

Monaca, PA 15061 BEAVER COUNTY

Telephone No. 412-774-1000

Has an SPCC Plan been prepared? Yes x No

Has it been certified by a Registered Professional Engineer? Yes X No

Name of person contacted: R.E. Coughanour, PH Manager * (1980 Mr. McC 2/6)
J.E. Grande, Chief Process Engineer

Means of contact: At facility x Nearest Office

Telephone Other

Comments:

This facility has fuel oil storage of about 1,000,000 gallons.

The Plan appears to be very complete.

* Scott McPhillamy checked again on 7/21/76

Inspected by Richard W. Fullner
Wheeling Field Office

Date: 4-15-75

Time: 1045

Mr.

SPCC INSPECTION DATABASE

CASE # : MD-84-099 DATE OF TARGET: _____
FACILITY NAME: GULF OIL PRODUCTS CO.
ADDRESS: P.O. BOX 830, MARINE Rd.
SALISBURY, MD. 21801
COUNTY: WICOMICO TARGET BY: _____
PHONE: 301-712-1555 FAC. REP. JUDY TAYLOR, SUPER.
DATE INSPECTED: 7-31-84 INSPECTORS: C. LEE.

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME: _____
ADDRESS: _____
PHONE: _____ FAC. REP. _____

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: 1957 DATE PLAN REQ'D: 1974
OIL STORAGE CAPACITY ABOVEGROUND: 4,877,904 GALLONS
UNDERGROUND: _____ GALLONS
SPCC PLAN PREPARED: Y (Y/N) AVAILABLE FOR REVIEW: Y (Y/N)
DATE CERTIFIED: 6-11-74 SEAL AFFIXED: Y (Y/N)
4-27-82
ENGINEER: VICTOR F. METERS JR LICENSE #: 4499 STATE: MD.
FAC. RECORD OF REVIEW OF PLAN EVERY THREE YEARS: _____ (Y/N)
DATES OF REVIEW: 7-31-84
SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N (Y/N)
TWO SPILLS IN PAST 12 MONTHS: N (Y/N)

PAGE 1783
TDD# 8407-20

SPPC PLAN INSPECTION

A. Facility Name GULF OIL PRODUCTS Co.
Address PO Box 830 MARINE RD
SALSBURY, MD 21801 (ZIP)

County WICOMICO
Phone No. 301-712-~~228~~1955

Contact: ~~VICTOR F.~~ JUDY TAYLOR Title: SUPERVISOR, TERM. OPS

- B. Has an SPPC Plan been prepared? Yes No
- Has an SPPC Plan been implemented? Yes No
- Has it been certified by a Registered Professional Engineer? Yes No

Name VICTOR F. MEYER, JR. No. 4499 State MD

C. Facility start-up date 1957

D. Date SPPC plan was certified 4/27/82 (original 6/11/74)

E. Date(s) Plan Revised 1/4/78

F. Date(s) Plan Reviewed 7/31/84

G. Has the name of the facility changed within the last year? Yes No

H. Has the location of the facility changed within the last year? Yes No

I. Closest water body WICOMICO RIVER Distance adjacent

J. Above Ground Storage Product Below Ground Storage Product Produce

Tank No	Capacity	Product	Below Ground Storage	Product
101	217,075 gal	Gasoline		
105	1,006,953 gal	"		
101	882,699	"		
106	216,059	"		
103	451,257	Kerosene		
104	2,287,317	#2 Fuel		

SPCC PLAN INSPECTION

ID# 8407-20

Page 2

K. Comments:

- a. Diking Type Earth Appears Adequate
- b. Manual valve on dike drain (normally capped & locked)
- c. Sorbents or booms stored on site
- d. Curbing at load or unload area
- e. Drainage at load or unload areas to oil/water separator
- f. Underground tanks checked N/A Time spent _____
- g. High level alarms on tanks no
- h. Security Type Fenced & Barb except @ River
- i. Personnel training (use out-of-plant drivers)
- j. Spill history none

* Gulf will be changed to "Standard of Southern Cal. f." as of 8/3/84

L. Estimated number of man hours involved in inspection 2.0 (whole hours)

"I certify the above to be accurate to the best of my knowledge."

Inspected by *C. S. ...*

Company Official *Judy M. Taylor*

Date 7/31/84

WICOMICO RIVER

EXXO
~~EXXON~~ TERMINAL - Property Line

NEW LINE OPENED
by state Hwy.

To River
(approx 1/8 mi)

OUTFALL

Filter Box

YARD DRAIN
VALVE (LOCKED)

LEADED
GASOLINE
105

#2 FUEL
oil
104

Gulf

Keros
103

UNLEADED
GASOLINE
102

UNLEADED
GASOLINE
106

UNLEADED
GASOLINE
101

OFFICE
BLDG.

Storm
Drain

Separate

TRENCH
Drain

8000 Gal
U.G. TANK

Rack

TRENCH
Drain

Storm
Drain

Wooded
Area

FIRE Pump House

DOCK AREA ROAD

Property 1500' Long (Approx 1000' shown)

Stewart
~~Stewart~~ Petroleum - Property Line

MAINE ROAD

FARM FIELD

ORIGINAL
Red

3/19/82
RTR

ORIGINAL
(Red)

SPCC Inspection REPORT

CASE # : PA-75-033

DATE OF TARGET:

FACILITY NAME: TEXACO, INC.

ADDRESS: 9 THORN STREET
CORAOPOLIS,

PA

COUNTY: ALLEGHENY

TARGET BY:

PHONE: (412)331-3400

FAC. REP.: E. J. OWENS

TITLE: TERMINAL SUPER.

DATE INSPECTED: 04/07/75

INSPECTORS: RICHARD W. FULLNER

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:

ADDRESS:

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE:

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND: 39,480,000GALLONS

UNDERGROUND: 15,000GALLONS

SPCC PLAN PREPARED: Y

AVAILABLE FOR REVIEW: Y

DATE CERTIFIED:

SEAL AFFIXED: Y

ENGINEER:

LICENSE #:

STATE:

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS:

DATES OF REVIEW:

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N

TWO SPILLS IN PAST 12 MONTHS: N

COMMENTS:

PA-75-033

SPCC PLAN INSPECTION

ORIGINAL
(Red)

Facility name Texaco, Inc.

Address 9 Thorn St.

Coraopolis, Pa. 15108 ALLEGHENY COUNTY

Telephone No. 412-331-3400

Has an SPCC Plan been prepared? Yes No

Has it been certified by a Registered Professional Engineer? Yes No

Name of person contacted: E. J. Owens
Terminal Superintendent

Means of contact: At facility Nearest Office

Telephone Other

Comments:

Storage: 39,480,000 above ground
15,000 under ground

Plan is very complete.

Inspected by Richard W. Fullner

Wheeling Field Office

Date: 4-7-75

Time: 1115

SPCC Inspection REPORT

CASE # : PA-75-037N

DATE OF TARGET:

FACILITY NAME: SHELL CHEM. CO-C/O GREAT LAKES

ADDRESS: TERM.&TRANSPORT CORP.-BOX 216
INDUSTRY, PA

COUNTY: BEAVER

TARGET BY:

PHONE: (412)643-9451

FAC. REP.: O. F. FARRELL
TITLE: TERMINAL MNGR.

DATE INSPECTED: 04/15/75

INSPECTORS: RICHARD W. FULLNER

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:
ADDRESS:

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE:

DATE PLAN REQ'D:

OIL STORAGE CAPACITY ABOVEGROUND:
UNDERGROUND:

GALLONS
GALLONS

SPCC PLAN PREPARED: Y

AVAILABLE FOR REVIEW: Y

DATE CERTIFIED:

SEAL AFFIXED: N

ENGINEER:

LICENSE #:

STATE:

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS:
DATES OF REVIEW:

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N
TWO SPILLS IN PAST 12 MONTHS: N

COMMENTS:

PA-75-037NC

SPCC PLAN INSPECTION

Facility name Shell Chemical Company
 Address C/o Great Lakes Terminal & Transport Corp.
P. O. Box 216
Industry, Pa. 15052 BEAVER COUNTY
 Telephone No. 412-643-9451

Has an SPCC Plan been prepared? Yes x No

Has it been certified by a Registered Professional Engineer? Yes No x

Name of person contacted: O. F. Farrell
Terminal Manager

Means of contact: At facility x Nearest Office
Telephone Other

Comments:

Mr. Farrell could not locate the plan at the time of my visit. The individual responsible for such matters was not in at the time.

On 4-21-75 Mr. Tom Gimbus called and said they did have a plan and agreed to mail a copy to me. A copy of the plan was received on 4-22-75. The plan was not signed by an engineer, however, so I discussed that with Mr. Gimbus. He will check with his people and see that the plan is properly certified.

Inspected by Richard W. Fullner
Wheeling Field Office

Date: 4-15-75

Time: 1400

ORIGINAL
(Red)

SPCC Inspection REPORT

CASE # : MD-84-097

DATE OF TARGET:

FACILITY NAME: CATO INC. (TEXACO TERMINAL)
ADDRESS: P.O. BOX 1036 MARINE Rd.
SALISBURY MD 21801

COUNTY: WICOMICO

TARGET BY:

PHONE: (301)546-1215

FAC. REP.: GEORGE EVANS
TITLE: MANAGER

DATE INSPECTED: 07/31/84

INSPECTORS: C. LEE

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:
ADDRESS:

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: 1957

DATE PLAN REQ'D: 1974

OIL STORAGE CAPACITY ABOVEGROUND: 3,792,000 GALLONS
UNDERGROUND: GALLONS

SPCC PLAN PREPARED: Y AVAILABLE FOR REVIEW: Y

DATE CERTIFIED: 07/19/74 SEAL AFFIXED: Y

ENGINEER: ANTHONY L. ANDUJAR

LICENSE #:711-E

STATE: PA

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS: Y

DATES OF REVIEW: 5/6/77;4/22/80;5/14/83

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N

TWO SPILLS IN PAST 12 MONTHS: N

ENFORCEMENT ACTIVITIES

NON DATE: NOV CASE #:

REFERRED TO ORC: ASSIGNED TO:

PROPOSED PENALTY: 0 NOV SENT:

ORC PENALTY: 0 HEARING DATE:

AMOUNT SETTLED: 0 DATE SETTLED:

AMOUNT COLLECTED: 0 DATE COLLECTED:

CASE CLOSED:

COMMENTS:

ORIGINAL
(Red)

SPCC INSPECTION DATABASE

CASE # : MD-84-097 DATE OF TARGET: _____
FACILITY NAME: CATO INC. (TEXACO TERMINAL)
ADDRESS: P.O. Box 1036 MARINE Rd.
SALISBURY, MD. 21801
COUNTY: Wicomico TARGET BY: _____
PHONE: 301-546-1215 FAC. REP. GEORGE EVANS MGR.
DATE INSPECTED: 7-31-84 INSPECTORS: CESAR LEE

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME: _____
ADDRESS: _____
PHONE: _____ FAC. REP. _____

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: 1957 DATE PLAN REQ'D: 1974
OIL STORAGE CAPACITY ABOVEGROUND: 3,792,000 GALLONS
UNDERGROUND: _____ GALLONS
SPCC PLAN PREPARED: Y (Y/N) AVAILABLE FOR REVIEW: Y (Y/N)
DATE CERTIFIED: 7-19-74 SEAL AFFIXED: Y (Y/N)
ENGINEER: ANTHONY L. ANDUSTAR LICENSE #: 711-E STATE: PA
FAC. RECORD OF REVIEW OF PLAN EVERY THREE YEARS: 3 (Y/N)
DATES OF REVIEW: 5-14-83-4-22-80-5-6-77
SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N (Y/N)
TWO SPILLS IN PAST 12 MONTHS: N (Y/N)

ENFORCEMENT SCREEN

NON DATE: _____
NOV CASE #: _____ REFERRED TO ORC: _____
ASSIGNED TO: _____
PROPOSED PENALTY: _____ NOV SENT: _____
ORC PENALTY: _____ HEARING DATE: _____
AMOUNT SETTLED: _____ DATE SETTLED: _____
AMOUNT COLLECTED: _____ DATE COLLECTED: _____
CASE CLOSED DATE: _____

SPCCDAT2

ORIGINAL
(Red)

SPCC Inspection REPORT

CASE # : MD-84-097

DATE OF TARGET:

FACILITY NAME: CATO INC. (TEXACO TERMINAL)

ADDRESS: P.O. BOX 1036 MARINE Rd.
SALISBURY MD 21801

COUNTY: WICOMICO

TARGET BY:

PHONE: (301)546-1215

FAC. REP.: GEORGE EVANS

TITLE: MANAGER

DATE INSPECTED: 07/31/84

INSPECTORS: C. LEE

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME:

ADDRESS:

PHONE:

FAC. REP:

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: 1957

DATE PLAN REQ'D: 1974

OIL STORAGE CAPACITY ABOVEGROUND: 3,792,000 GALLONS
UNDERGROUND: GALLONS

SPCC PLAN PREPARED: Y AVAILABLE FOR REVIEW: Y

DATE CERTIFIED: 07/19/74 SEAL AFFIXED: Y

ENGINEER: ANTHONY L. ANDUJAR

LICENSE #: 711-E STATE: PA

FAC. RECORD REVIEW OF PLAN EVERY THREE YEARS: Y

DATES OF REVIEW: 5/6/77; 4/22/80; 5/14/83

SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N

TWO SPILLS IN PAST 12 MONTHS: N

ENFORCEMENT ACTIVITIES

NON DATE: NOV CASE #:

REFERRED TO ORC: ASSIGNED TO:

PROPOSED PENALTY: 0 NOV SENT:

ORC PENALTY: 0 HEARING DATE:

AMOUNT SETTLED: 0 DATE SETTLED:

AMOUNT COLLECTED: 0 DATE COLLECTED:

CASE CLOSED:

COMMENTS:

ORIGINAL
(Red)

SPCC INSPECTION DATABASE

CASE # : MD-84-097 DATE OF TARGET: _____
FACILITY NAME: CATO INC. (TEXACO TERMINAL)
ADDRESS: P.O. Box 1036 MARINE Rd.
SALISBURY, MD. 21801
COUNTY: Wicomico TARGET BY: _____
PHONE: 301-546-1215 FAC. REP. GEORGE EVANS MGR.
DATE INSPECTED: 7-31-84 INSPECTORS: CESAR LEE

OWNER/OPERATOR INFO (IF DIFFERENT FROM ABOVE):

NAME: _____
ADDRESS: _____
PHONE: _____ FAC. REP. _____

(SYNOPSIS OF BUSINESS OPERATIONS)

START OPS DATE: 1957 DATE PLAN REQ'D: 1974
OIL STORAGE CAPACITY ABOVEGROUND: 3,792,000 GALLONS
UNDERGROUND: _____ GALLONS
SPCC PLAN PREPARED: Y (Y/N) AVAILABLE FOR REVIEW: Y (Y/N)
DATE CERTIFIED: 7-19-74 SEAL AFFIXED: Y (Y/N)
ENGINEER: ANTHONY L. ANDUSTAR LICENSE #: 711-E STATE: PA
FAC. RECORD OF REVIEW OF PLAN EVERY THREE YEARS: 3 (Y/N)
DATES OF REVIEW: 5-14-83-4-22-80-5-6-77
SPILL HISTORY: 1000 GAL IN PAST 12 MONTHS: N (Y/N)
TWO SPILLS IN PAST 12 MONTHS: N (Y/N)

ENFORCEMENT SCREEN

NON DATE: _____
NOV CASE #: _____ REFERRED TO ORC: _____
ASSIGNED TO: _____
PROPOSED PENALTY: _____ NOV SENT: _____
ORC PENALTY: _____ HEARING DATE: _____
AMOUNT SETTLED: _____ DATE SETTLED: _____
AMOUNT COLLECTED: _____ DATE COLLECTED: _____
CASE CLOSED DATE: _____

SPCCDAT2

ORIGINAL
(Red)

SPCC PLAN INSPECTION

TDD# EP3-8209-60

Page 2

K. Comments:

- a. Diking pits Type _____ Appears Adequate X
- b. Manual valve on dike drain _____
- c. Sorbents or booms stored on site YES
- d. Curbing at load or unload area NO
- e. Drainage at load or unload areas to oil water separator _____
- f. Underground tanks sticked YES Time span daily
- g. High level alarms on tanks NO
- h. Security YES Type lock on over fill pipes
- i. Personnel training _____
- j. Spill history 600 gallon spill on 10/2/82.
Inspection is a result of spill.

Gulf took facility over from Amoco Dealer on midnight October 1st.

Gulf is preparing an spcc plan for this facility. As soon as ~~the~~ the plan is prepared a copy of it will be submitted to USEPA John Harsch.

L. Estimated number of man hours involved in inspection 2 (whole hours)

"I certify the above to be accurate to the best of my knowledge."

Inspected by [Signature]

Company Official [Signature]

Date 10/4/82

SPCC PLAN INSPECTION

JOHN HARVEY

TDD# EP3-8209-60

A. Facility Name Gulf Refining and Marketing Co. (SERVICE STATION)

Address Delaware Turf. Service Center

PO Box 10326 Wilmington Delaware 19850
location 1/2 mile south Exit 3 on I95 (ZIP)

County New Castle

Phone No. 302-368-4783

Contact: John Leahy Title: Manager

ORIGINAL
REGISTERED
(1987)

B. Has an SPCC Plan been prepared? Yes No

Has an SPCC Plan been implemented? Yes No

Has it been certified by a Registered Professional Engineer? Yes No

Name _____ No. _____ State _____

C. Facility start-up date prior to 1974

D. Date SPCC plan was certified _____

E. Date(s) Plan Revised _____

F. Date(s) Plan Reviewed _____

G. Has the name of the facility changed within the last year? Yes No

H. Has the location of the facility changed within the last year? Yes No

I. Closest water body Christiana Creek Distance 1/2 mile

Above Ground Storage	Product	Below Ground Storage	Product
		5-20,000 gallon	gasolene
		1-20,000 gallon	diesel
		1-10,000 gallon	diesel

New facility?

POSO 1783
TDD# 8407-10

SPCC PLAN INSPECTION

A. Facility Name CATO INC. (TEXACO TERMINAL)
Address PO Box 1036 Marine Rd
Salisbury, MD 21801 (ZIP)

County Wicomico

Phone No. 301-546-1215

Contact: GEORGE EVANS Title: OPS MANAGER

B. Has an SPCC Plan been prepared? Yes No

Has an SPCC Plan been implemented? Yes No

Has it been certified by a Registered Professional Engineer? Yes No

Name ANTHONY L. ANDUSAR No. 711-E State PA

C. Facility start-up date 1957

D. Date SPCC plan was certified 7/19/74

E. Date(s) Plan Revised N/A

F. Date(s) Plan Reviewed 5/14/83; 4/22/80; 5/6/77

G. Has the name of the facility changed within the last year? Yes No

H. Has the location of the facility changed within the last year? Yes No

I. Closest water body Wicomico River Distance 2000 ft

J. Above Ground Storage Product Below Ground Storage Product

see plan/nop

SPCC PLAN INSPECTION

IDDP 8407-20

Page 2

K. Comments:

- a. Diking Type gravel on top of sand Appears Adequate
- b. Manual valve on dike drain
- c. Sorbents or booms stored on site
- d. Curbing at load or unload area
- e. Drainage at load or unload areas to oil water separator
- f. Underground tanks checked N/A Time span _____
- g. High level alarms on tanks
- h. Security Type Fenced & Barbed
- i. Personnel training continuous
- j. Spill history none

s. Monthly water samples for analysis done
 a see attached plan drawing

L. Estimated number of man hours involved in inspection 100 (whole hours)

"I certify the above to be accurate to the best of my knowledge."

Company Official George D. Jones

Inspected by C. S. ...

Date 7/31/84

BY CL DATE 7/31/88 DIV _____ SHEET 3 OF 7
 CHKD BY _____ DATE _____ DEPT TAT III W.O. NO. _____
 PROJECT SPCC / Wicomico, MD
 SUBJECT CAT, Inc ; Salisbury, MD

